

ASSESSMENT REPORT - Project: 15247.00

Armow Wind Power Project Tonality Assessment Report – R221


Prepared for:

SP Armow Wind Ontario LP.
2050 Derry Road West, 2nd Floor
Mississauga, Ontario
L5N 0B9

Prepared by:



Ibbtida Khan



Allan Munro, B.A.Sc., P.Eng.



Payam Ashtiani, B.A.Sc., P.Eng.

07 February 2020

Revision History

Revision Number	Description	Date
1	Tonality Investigation Noise Report	07/02/2020

Table of Contents

Table of Contents	3
List of Tables	4
List of Figures	4
List of Appendices	5
1 Introduction	7
2 Noise Source Summary	7
2.1 Tonal Audibility Results from E-Audit.....	8
3 Tonal Assessment Details	9
3.1 Test Equipment.....	9
3.2 Measurement Methodology.....	10
3.3 Data Reduction and Filtering	10
3.4 Measurement Location.....	11
3.5 Sample size Reporting Requirements.....	13
3.6 Operational Conditions	13
4 Tonal Assessment Results	13
4.1 Weather Conditions.....	13
4.2 Wind Direction	13
4.3 Measured Sound Levels.....	14
4.4 Measured Tonality	15
4.4.1 Tonal Assessment – 10m wind speed.....	16
4.4.1 Tonal Assessment - hub-height wind speed	16
5 Assessment of Compliance	17
References	18

List of Tables

Table 1 Summary of Wind Turbine Noise Emission Audit.....	8
Table 2 – T88 - Tonality Assessment Summary	8
Table 3 Summary of Relevant Tones T88.....	9
Table 4: Monitoring Period for Each Receptor (DD/MM/YYYY).....	9
Table 5: Equipment Details.....	10
Table 6: Power Filtering Summary	11
Table 7: Receptor Measurement Locations.....	12
Table 8: Predicted Impact from Facility of Excluded Frequencies	12
Table 9: General Weather Conditions – Range of Measured Values	13
Table 10: R221 Sound levels measured for Turbine ON and OFF (Downwind – T14).....	14
Table 11: Tonality Summary – R221 – 450Hz [422Hz – 478Hz].....	16
Table 12 Tonality Assessment at each half-integer hub-height wind speed 450 Hz [442Hz-478Hz]	17

List of Figures

Figure 1: R221 - Measured Sound Levels for Turbine ON and Background vs Wind Speed (Downwind – T14)	15
--	----

List of Appendices

Appendix A – Location Details

Figure A.01 – Site Plan

Figure A.02 – Monitor and Receptor Location – R221

Figure A.03 – Site Photo – R221

Appendix B – Wind Rose

Figure B.01 – Wind Rose – R221

Appendix C – Calibration Records

Appendix D – Sample Tone Plot

Appendix E – AWPP Scope of Work Letter

Executive Summary

The Ministry of Environment, Conservation and Parks (“MECP”) has ordered (Provincial Officer’s Order #2868-B8VRY4-1 dated June 19, 2019) the Armow Wind Power Project to conduct a tonal audibility assessment at receptor locations most impacted by Armow wind turbines identified in the REA as T50, T30, **T88**, T102, T75 and T95. This report is specific to Turbine T88. The tonality assessment has been conducted at the worst-case receptor for turbine T14 which is the same turbine model as T88 (SWT-2.3-101 1.903MW, hub 99.5) as agreed to by the MECP and as per section 3.c of the Armow Scope of Work document dated July 26, 2019.

Aercoustics Engineering Limited (“Aercoustics”) has been retained by SP Armow Wind Ontario LP (“Armow”) to complete this tonal audibility assessment at receptor location R221. The report has been prepared to facilitate submission to the MECP, in accordance with the Provincial Officer’s Order #2868-B8VRY4 and Armow Scope of Work document dated July 26, 2019.

Armow operates under REA #4544-9B7MYH, issued on October 9, 2013.

The tonality investigation has been completed as per the methodology outlined in Parts D 3.8.3 of the “*MECP Compliance Protocol for Wind Turbine Noise*” (Updated: April 21, 2017).

The tonal audibility calculation methodology followed that of ISO 1996-2:2017 (ISO/PAS 20065:2016) with modifications to adapt the method to wind turbine immission measurements. The tonal adjustment structure followed sections E5.1 and E5.5.2 of the 2017 Compliance Protocol.

No tone was present at R221 which warranted a Tonal Adjustment in any 10m wind bin. Thus, the Turbine T14, T88 and turbines of the same type (SWT-2.3-101 2.030MW, hub 99.5) are assessed to be compliant with the acoustic requirements set out in the REA.

1 Introduction

The Ministry of Environment, Conservation and Parks (“MECP”) has ordered (Provincial Officer’s Order #2868-B8VRY4-1 dated June 19, 2019) the Armow Wind Power Project to conduct a tonal audibility assessment at receptor locations most impacted by Armow wind turbines identified in the REA as T50, T30, **T88**, T102, T75 and T95. This report is specific to Turbine T88. The tonality assessment has been conducted at the worst-case receptor for turbine T14 which is the same turbine model as T88 (SWT-2.3-101 1.903MW, hub 99.5) as agreed to by the MECP and as per section 3.c of the Armow Scope of Work document dated July 26, 2019.

An alternative surrogate turbine was chosen as the closest respective receptors to turbine T88 are in the upwind direction.

Aeroustics Engineering Limited (“Aeroustics”) has been retained by SP Armow Wind Ontario LP (“Armow”) to complete this tonal audibility assessment at receptor location V556. The report has been prepared to facilitate submission to the MECP, in accordance with the Provincial Officer’s Order #2868-B8VRY4 and Armow Scope of Work document dated July 26, 2019.

Armow operates under REA #4544-9B7MYH, issued on October 9, 2013.

The tonality investigation has been completed as per the methodology outlined in Parts D 3.8.3 of the *“MECP Compliance Protocol for Wind Turbine Noise”* (Updated: April 21, 2017).

The tonal audibility calculation methodology followed that of ISO 1996-2:2017 (ISO/PAS 20065:2016) with modifications to adapt the method to wind turbine immission measurements. The tonal adjustment structure followed sections E5.1 and E5.5.2 of the 2017 Compliance Protocol.

This report outlines the measurement methodology, results, and a comparison of the measured turbine tonal audibility to the tonal adjustment structure from ISO1996-2:2007 Annex C.

2 Noise Source Summary

Aeroustics was retained before this assessment to conduct E-Audits to verify the noise emission of turbines at the Armow Wind Power Project.

The purpose of the E-Audits was to confirm whether equipment was operating as per manufacturer’s specifications and satisfies the sound power level specified in the REA Appendix B. The E-Audits reports have been prepared to facilitate submission to the MECP, in compliance with acoustic audit conditions outlined in the REA (Specifically, Section F – Wind Turbine Acoustic Audit – Emission).

Wind Turbine Generator T88 was audited utilizing International Standard IEC 61400-11 (Edition 3.0, released 2012-11), “Wind Turbine generator systems – Part 11: Acoustic noise measurement techniques”.

Table 1 Summary of Wind Turbine Noise Emission Audit

Turbine ID	Turbine Model	Report ID
T88	Siemens SWT-2.3-101 1.903MW, hub 99.5m	15247.00.T88.RP3

Detailed measurement reports for T88 (Report ID: 15247.00.T88.RP3) outline the apparent sound power level, measurement uncertainties and tonal audibility results.

2.1 Tonal Audibility Results from E-Audit

Results of the tonality assessment of the acoustic audit for T88 is summarised in Table 2.

Table 2 – T88 - Tonality Assessment Summary

Wind Speed (m/s)	Frequency (Hz)	Tonality, ΔL_{tn} (dB)	Tonal audibility, ΔL_a (dB)	FFT's with tones	Total # of FFT's	Presence (%)
8	134	-5.0	-2.97	58	59	98%
8.5	134	-4.1	-2.12	86	86	100%
	423	-5.1	-2.92	77	86	90%
9	135	-4.1	-2.11	79	79	100%
	425	-3.0	-0.81	71	79	90%
9.5	135	-2.9	-0.91	81	82	99%
	424	-1.2	1.02	82	82	100%
10	136	-3.2	-1.17	54	55	98%
	429	0.1	2.28	48	55	87%
10.5	139	-2.3	-0.33	75	77	97%
	442	2.1	4.31	61	77	79%
11	136	-2.0	0.06	59	96	61%
	454	4.1	6.39	20	96	21%
11.5	134	-2.2	-0.14	48	76	63%
	450	3.9	6.14	38	76	50%
12	131	-1.4	0.59	12	53	23%
	450	3.8	6.04	36	53	68%

Table 3 presents a summary of the relevant tones for this assessment noted from the E-audits and includes the frequency range, tonal audibilities and the corresponding turbine operational parameters during which elevated tonal audibility levels were observed.

Table 3 Summary of Relevant Tones T88

Turbine ID	Frequency Range (Hz)	Tonal Audibility (dB)	Hub Height Wind Speed Range (m/s)	Electrical Power Output Range (kW)
T88	450Hz [422Hz – 478Hz]	1.0 – 6.0	9.5 – 12	1645 - 2030

3 Tonal Assessment Details

The acoustic audit was conducted at receptor R221¹. This location is closest to turbine T14. Turbine T14 is the same model turbine as T88 (SWT-2.3-101 1.903MW, hub 99.5) and was chosen as the alternative surrogate turbine as the closest respective receptors to turbine T88 are in the upwind direction compared to the predominant wind direction for the Armow Wind Power Project.

Monitoring at R221 spanned the following dates, summarized in Table 4.

Table 4: Monitoring Period for Each Receptor (DD/MM/YYYY)

Location	Monitoring Start Date	Monitoring End Date
R221	27/04/2016	19/10/2016

3.1 Test Equipment

The measurement equipment used for the Tonal Assessment, both acoustic and environmental, is detailed below. Equipment specifications and measurement positions comply with MECP Compliance Protocol sections *D2 – Instrumentation* and *D3 – Measurement Procedure*, respectively. Each remote monitoring unit is comprised of the following:

- One (1) Type 1 sound level meter, with microphone and pre-amplifier mounted at a height of 4.5 meters, at least 5 meters from any large reflecting surfaces.
- One (1) primary and one (1) secondary windscreen for the microphone. The 1/3 octave band insertion loss of the secondary windscreen has been tested and was accounted for in the data analysis.
- One (1) anemometer, mounted at a height of 10 metres above ground level (“10-m AGL”).

¹ Receptor IDs taken from the Noise Assessment Report by A. Brunskill, D. Eaton and E.Crivella dated September 9, 2013 [3]

Table 5 provides the specific model and serial numbers for the measurement equipment used during the measurement campaign.

Table 5: Equipment Details

Location	Equipment	Make/Model	Serial Number
R221	Sound Level Meter	B&K 2250	3006579/3004506
	Microphone	B&K 4189	2919502/3036522
	Pre-Amplifier	B&K ZC 0032	21158/24551
	Weather Anemometer	Vaisala WXT 520	K0550007/J4830029

The measurement chain was calibrated before and after the measurement campaign using a type 4231 Brüel & Kjær acoustic calibrator.

3.2 Measurement Methodology

For the duration of the measurement campaign, acoustic and anemometer data was logged simultaneously in one-minute intervals. The acoustic data included A-weighted overall equivalent sound levels (LAeq), percentile statistical levels (L90), and 1/3 octave band levels between 20 Hz and 10,000 Hz. The recorded weather data included average wind direction, wind speed, temperature, relative humidity, and atmospheric pressure. The maximum wind speed for each one-minute interval was also stored.

To account for the effect of wind speed on the measured sound level, measurement intervals are sorted into integer wind bins based on the measured 10 m wind speeds. Each bin ranges from 0.5 m/s below to 0.5 m/s above each respective wind bin (i.e. 5 m/s wind bin represents all intervals with average wind speeds between 4.5 m/s and 5.5 m/s).

3.3 Data Reduction and Filtering

The data reduction procedures used on the measurement data to remove invalid data points from the assessment are detailed below. These procedures are in accordance with Section D5.2 of the Protocol and in accordance with the measurement equipment specifications. An additional filter based on the difference between LAeq and L90 level is included to automatically exclude transient noise contamination.

A measurement interval is excluded if any one of the following criteria are not satisfied:

- The interval occurred between 10pm – 5am
- No precipitation was detected 60 minutes before and 60 minutes after the interval
- The ambient temperature was above -10°C

The purpose of the filters listed above is to exclude intervals where the data quality is reduced due to extraneous events (such as vehicle pass-bys), unusable environmental conditions (such as rain), or equipment operating outside of its specifications. Intervals

that pass the filtering criteria listed above are sorted into Turbine ON or Background periods based according to the conditions listed below. If neither Turbine ON or Background conditions are met, the data point is excluded.

- Turbine ON: Armow turbines must be rotating and generating power
- Background: Armow turbines must be parked and not generating power

The Protocol also requires additional criteria be met by each Turbine ON data point based on the conditions of the nearest turbine to each receptor. Specifically,

“Only downwind data will be considered in the analysis. With reference to the Turbine location, downwind directions are ± 45 degrees from the line of sight between the Turbine and receptor/measurement location.” {Section D5.2 (4)}

The following additional power filter was applied to specifically assess operational conditions when the highest tonal audibility values were measured during the E-audit testing at T88.

Table 6: Power Filtering Summary

Location	Turbine	Power Output (kW)
R221	T14	≥ 1645

3.4 Measurement Location

Monitoring was conducted at the vacant lot receptor R221. R221 has a predicted impact of 39.7 dBA as per level predicted from an “As Built” noise model based on the original CadnaA noise prediction model. The following table provides a summary of the receptor locations. Detailed site plans showing the receptor and audit locations are attached in Appendix A.

Table 7: Receptor Measurement Locations

Audit Receptor ID Turbine ID		R221 T14
Receptor	UTM Coordinates (X,Y)	17T 466316mE 4896175mN
	Distance to Turbine (m)	745
	Receptor Height (m)	4.5
	Predicted Level (dBA)*	39.7
Monitor	UTM Coordinates (X,Y)	17T 466308mE 4896131mN
	Distance to Turbine (m)	700
	Monitor Height (m)	4.5
	Predicted Level (dBA)*	39.7

*Predicted Level from Aercoustics' acoustic model

Flora and Fauna

Ambient contamination from flora and fauna was present to varying degrees at the measurement location. Transient contamination (dogs barking etc.) are removed by the listening tests. Insects, birds, and noise from leaves and crops rustling were present to varying degrees in the environment surrounding all receptors; this noise is present to greater degrees at high frequencies and those frequencies were excluded to minimize contamination from insect noise.

Impact of Excluded Frequencies

Analysis of the measured sound levels for R221 were limited to 1/3rd octave band frequencies below 2500 Hz. This frequency band was excluded to minimize contamination of the acoustic measurements from steady ambient sources such as insects. The predicted impact at these frequencies is presented in Table 8.

Table 8: Predicted Impact from Facility of Excluded Frequencies

Measurement Location	Predicted Facility Immission, 2500 Hz – 10000 Hz octave bands ²
R221	25.5 dBA

The contribution from the wind facility at these frequencies is small because high frequency sound is more efficiently absorbed by the atmosphere. The predicted facility

² Contribution by octave band frequency determined using CadnaA model

sound impact at from frequencies excluded from the measurement data have been added back to the Turbine-Only sound level.

3.5 Sample size Reporting Requirements

As per Section D3.8.3 Tonality (tonal assessment) of the MECP protocol, at least 5 one-minute intervals are required for wind turbine noise and background noise (wind turbines parked). These intervals shall be as close as possible to the integer wind speed. In addition, the MECP has required that the five (5) one-minute measurements per wind speed bin are to include the entire assessment range of the turbine and is not limited to wind speed bins of 4-7 m/s.

3.6 Operational Conditions

Turbine operational data for the duration of the measurement campaign was supplied by Pattern Operation Control Centre. Measurement data at receptor was filtered to include only intervals when all turbines in the immediate vicinity were operational, or, in the case of the ambient noise measurements, were not operational. The turbines included in this study were chosen such that when they are turned off, the partial impact of the remaining turbines was less than 30dBA; 10dB below the sound level limit. The specific turbines parked for ambient measurements were T7, T8, T9, T10, T13, T14, T15, T18, T26, T27, T28, T29, T30, T31, T32, T40, T41, T42, T43, T44, T47, T49, T50, T57, T58, T60, T61, T63, T69, T82, T94, T96, T97, T102, T103, T105, T106, T107, T112, T113, T114 and T115.

4 Tonal Assessment Results

Acoustic and weather data measured during the Tonal Assessment are summarized in the following section.

4.1 Weather Conditions

General weather conditions measured over the course of the tonality investigation are summarized in Table 9.

Table 9: General Weather Conditions – Range of Measured Values

	10-m AGL			
	Atmospheric Pressure [hPa]	Wind Speed [m/s]	Relative Humidity [%]	Temperature [°C]
Minimum	966	0.0	20	0
Maximum	995	14.6	93	27

4.2 Wind Direction

A Wind rose representing the recorded wind directions during the audit is reported in Appendix B. Wind direction recorded from the turbine yaw angle, and wind speeds measured from the 10-m AGL anemometer, were combined to prepare the wind rose. The

wind speeds from 1-7 m/s at 10-m AGL represent the I-audit wind bins as per Section E5.5 of the Protocol.

4.3 Measured Sound Levels


Table 10 details the sound levels measured at the receptors when all the nearby turbines were on (Turbine ON) and when all the nearby turbines were off (Turbine OFF). The Turbine ON and Turbine OFF sound level presented are filtered as per the filters detailed in Section 3.3.

Table 10: R221 Sound levels measured for Turbine ON and OFF (Downwind – T14)

I-Audit Wind Bins (m/s)	Turbine ON			Turbine OFF		
	Number of Samples	LAeq [dBA]	Std Dev [dBA]	Number of Samples	LAeq [dBA]	Std Dev [dBA]
1	0	-	-	670	24.9	5.1
2	29	38.4	0.5	128	25.3	5.2
3	142	38.7	0.9	302	28.5	3.8
4	199	39.5	1.2	415	31.0	2.0
5	257	41.3	1.2	103	38.0	3.2
6	208	43.6	1.3	155	42.8	1.6
7	106	47.4	1.6	129	47.9	1.7

The following figures present the scatter plots showing each valid 1-minute interval measured sound level at R221 when all the nearby turbines were ON (Turbine ON + Background) and when all the nearby turbines were OFF (Turbine OFF). The Turbine ON and Turbine OFF sound level presented was using the filter outlined in section 3.3.

Figure 1: R221 - Measured Sound Levels for Turbine ON and Background vs Wind Speed (Downwind – T14)

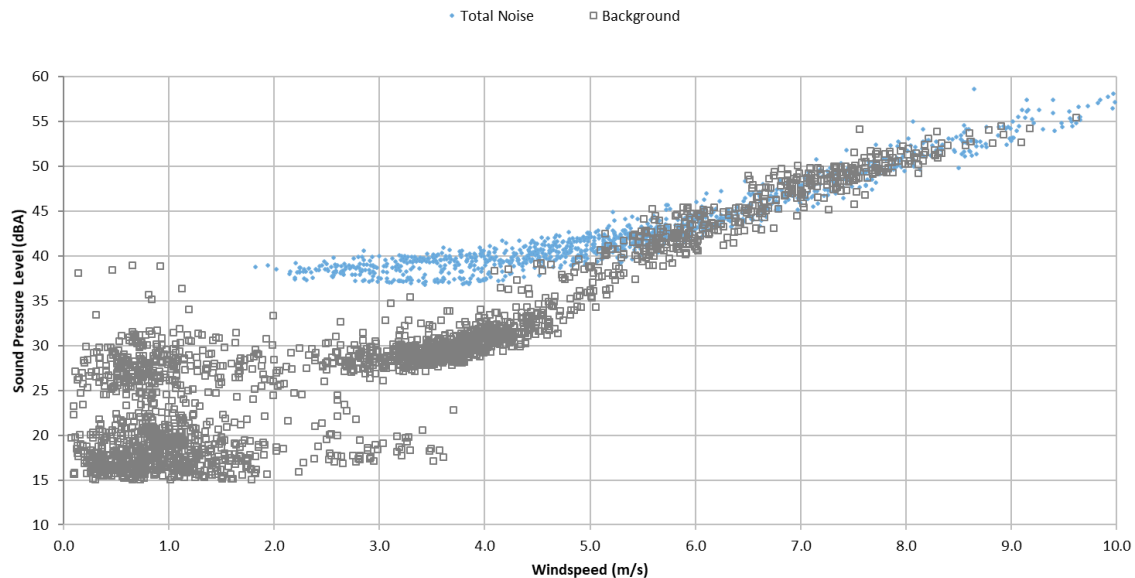

4.4 Measured Tonality

The tonal assessment has been completed using ISO/PAS 20065:2016 (Acoustic-Objective method for assessing the audibility of tones in noise-Engineering Method) and the tonal penalty structure taken from ISO 1996-2:2007 Annex C. Namely, Section 5.1 of the compliance protocol states:

If a tonal assessment ... indicates a tonal audibility value that exceeds 4 dB, the Ministry will require that a tonal penalty be applied at all Receptors in accordance with the penalties described in Annex C of ISO 1996-2, Reference [2]

The tonality analysis results of the Emission audit measurements for T88 were used as a basis for tones at receptors which were likely to have been generated by the closest turbine rather than an external source.

Tonality analysis was completed based on 1-minute narrow band spectra, ranging from 20 Hz to 3000 Hz with a frequency resolution of 2 Hz.

Narrowband data was acquired and calculated for each 1-minute interval used in the immission analysis and binned by wind speed. The mean tonal audibility of spectra in each wind bin was then evaluated to determine if a tonal adjustment would be applicable.

For a given spectra if the Tonal audibility is greater than 0dB then a tone is present. For all Spectra in which no tone is found, a tonal audibility of -10 dB is applied (as specified in Section 5.3.9 in ISO/PAS 20065:2016). The Mean Tonal Audibility values reported represent the energy average of all data points with an identified tone that falls within the same frequency of origin with the inclusion of data points with unidentified tones (i.e. -10 dB). A sample tone plot is provided in Appendix D.

4.4.1 Tonal Assessment – 10m wind speed

The presence of tones in the I-audit data binned by 10m wind speed was determined.

Tonal assessment summary table is provided in Table 11.

Table 11: Tonality Summary – R221 – 450Hz [422Hz – 478Hz]

10m Wind Speed (m/s)	Turbine ON Data points	# of Data Points with Tones	Tonal Presence	Mean Audibility, ΔL (dB)	Tonal Adjustment, K_T (dB)
1	0	0	-	-	-
2	29	0	0%	-10.0	-
3	142	5	4%	-8.5	0
4	199	16	8%	-6.7	0
5	257	8	3%	-8.4	0
6	208	0	0%	-10.0	0
7	106	0	0%	-10.0	0

Relevant tones from T14 (450 Hz) were found to be present at receptor R221. No tonal adjustment was found to be applicable at receptor R221 at any 10m wind speed bin.

4.4.1 Tonal Assessment - hub-height wind speed

The presence of tones in the I-audit data as a function of hub height wind speeds was also determined. The tonal analysis covered the same hub height wind speed range as the sound power level measurement of the E-audit test for Turbine T50. The turbine electrical power filter was removed, and all spectra were sorted into half-integer hub height wind speed bins using the methodology for the E-audit (IEC 61400-11 Ed 3.0) adapted for I-audit measurements. The results of this analysis provide the mean tonal audibility over the entire assessment range of the turbine (7.5m/s to 12m/s).

Table 12 Tonality Assessment at each half-integer hub-height wind speed 450 Hz [442Hz-478Hz]

Hub Height Wind Bin (m/s)	Turbine ON Data points	# of Data Points with Tones	Tonal Presence	Mean Audibility, ΔL (dB)	Turbine Power Output (kW)
7.5	716	0	0%	-10.0	990
8	694	0	0%	-10.0	1187
8.5	761	0	0%	-10.0	1389
9	399	0	0%	-10.0	1590
9.5	188	0	0%	-10.0	1701
10	214	0	0%	-10.0	1811
10.5	141	0	0%	-10.0	1848
11	177	10	6%	-7.6	1884
11.5	49	0	0%	-10.0	1892
12	43	19	44%	-1.4	1900

Similar to the tonal assessment binned by 10m wind speed, relevant tones from T14 (450 Hz) were found to be present at receptor R221 for some hub-height wind bins, however the tonal presence and mean audibility was relatively low compared to measurements at the E-audit location.

5 Assessment of Compliance

As per Section D5.6 of the Protocol, if a tone is identified at any of the wind speed bins, the average tonal audibility correction shall be added to the final noise contribution of the wind turbine at those wind speed bins.


No tone was present at R215 which warranted a Tonal Adjustment in any 10m wind bin. Thus, the Turbine T14, T88 and turbines of the same type (SWT-2.3-101 1.903MW, hub 99.5) are assessed to be compliant with the acoustic requirements set out in the REA.

References

- [1] V. Schroter, “Renewable Energy Approval #4544-9B7MYH ”, Ontario Ministry of the Environment, Toronto, ON, October 9, 2013.
- [2] Ministry of the Environment and Climate Change, “*Compliance Protocol for Wind Turbine Noise*”, Ontario Ministry of the Environment, Toronto, ON, April 21, 2017.
- [3] A. Brunskill, D. Eaton and E.Crivella , “Armow Wind Farm, Ontario Noise Impact Assessment ”, GL Garrad Hassan, 9 September 2013.

Appendix A

Location Details

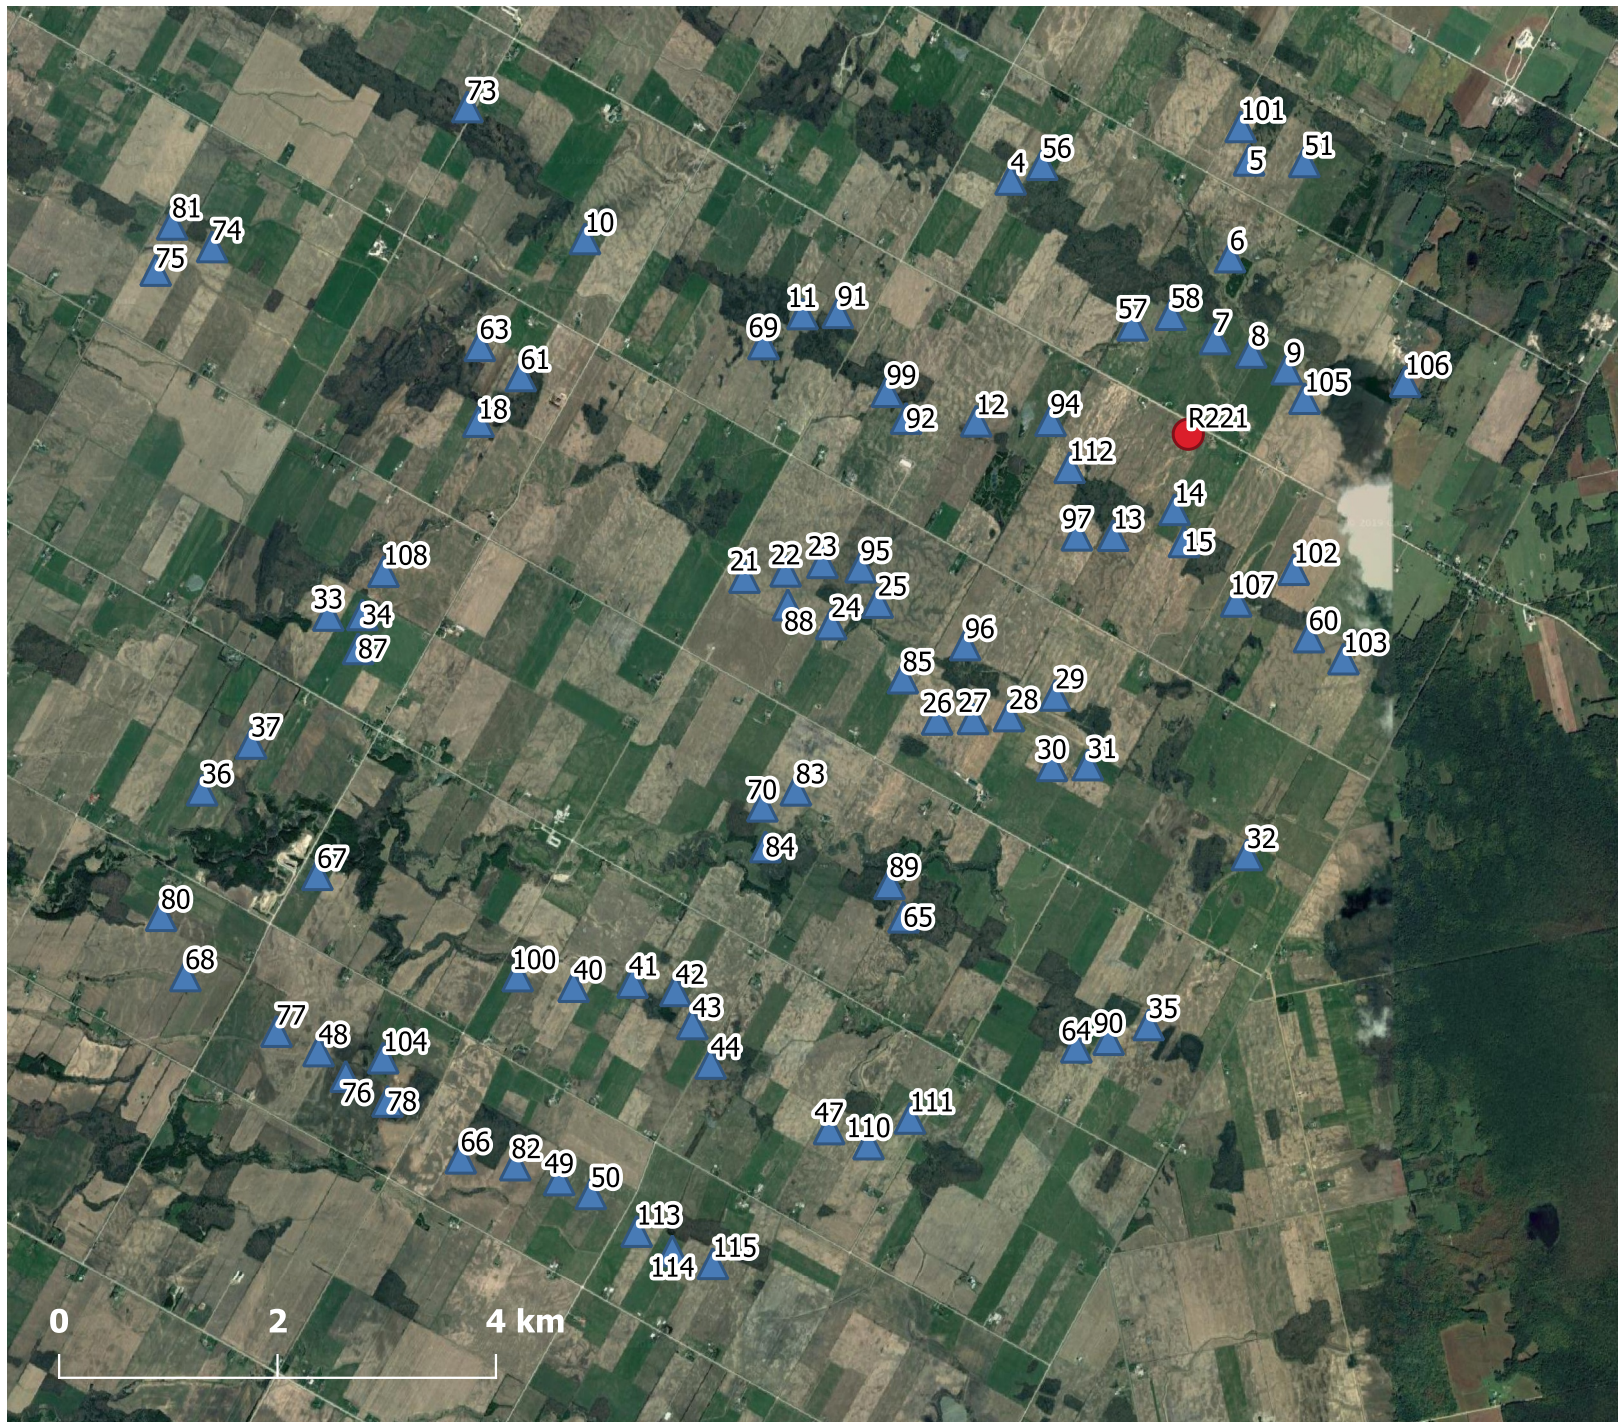

Legend

- ▲ Armow Turbines
- R221 Monitor



Project ID: 15247.00

Drawn by: IK

Reviewed by: AM

Date: August 29, 2019

Revision: 1

Scale: As Indicated

Armow Wind Power Project
Tonal Assessment R221

Appendix A.1

Site Plan Overview



Legend

- ▲ Arrow Turbines
- R221 Monitor
- Bruce County Rd 15



Project ID: 15247.00
Drawn by: IK
Reviewed by: AM
Date: August 29, 2019
Revision: 1

Scale: As Indicated

Arrow Wind Power Project
Tonal Assessment R221

Appendix A.2

Measurement Location



Project ID: 15247.00
Drawn by: IK
Reveiwed by: AM
Date: August 29, 2019
Revision: 1

Scale: As Indicated


Armow Wind Power Project
Tonal Assessment R221

Appendix A.3

Site photo

Appendix B

Wind Roses

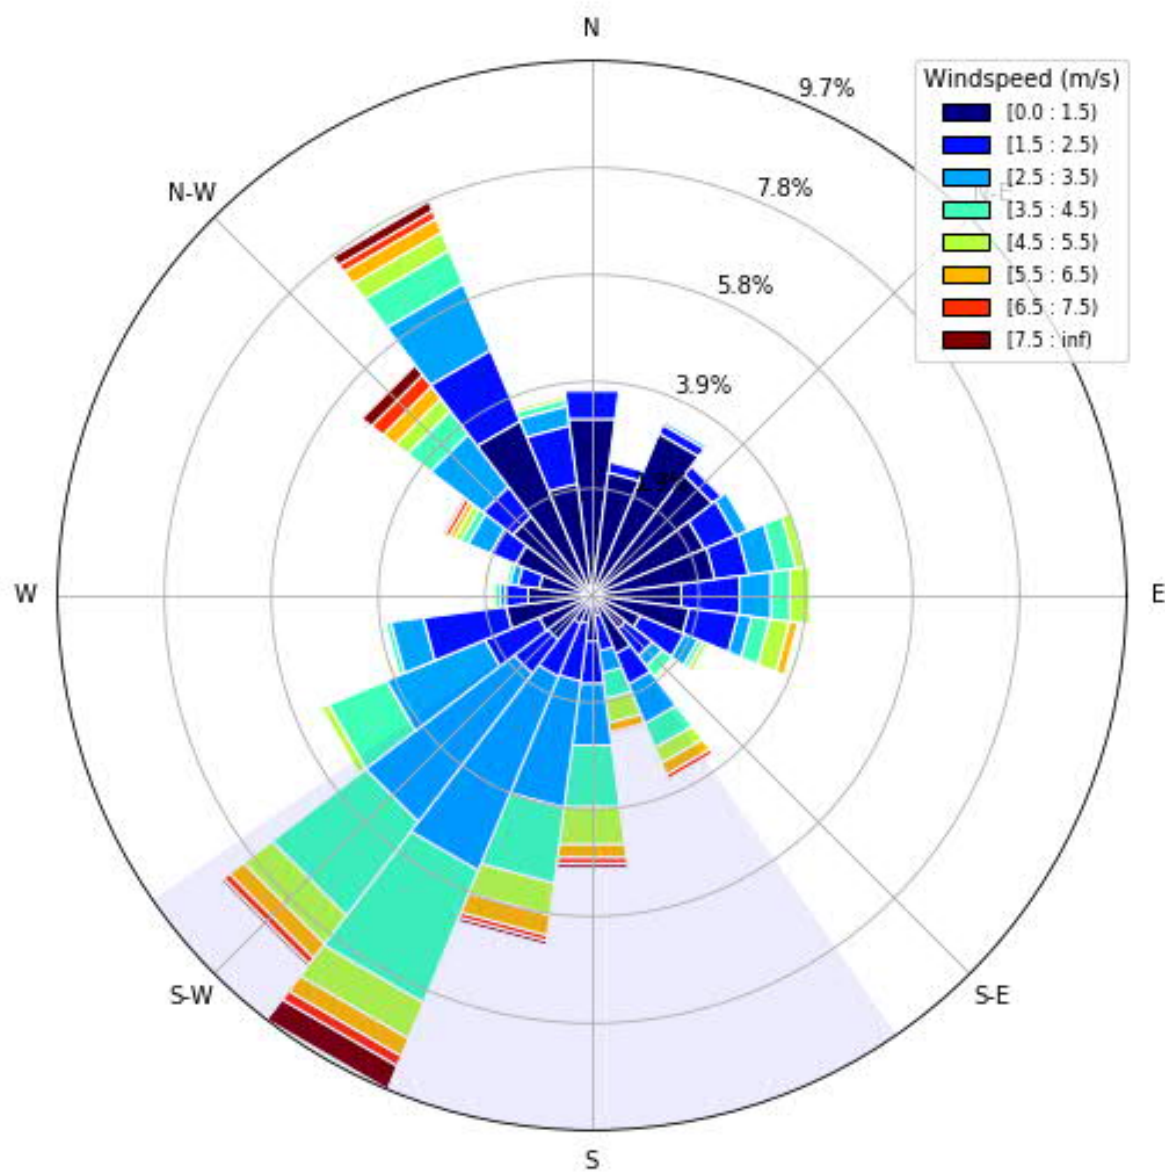

Project ID: 15247.00
Drawn by: IK
Reveiwed by: AM
Date: August 29, 2019
Revision: 1

Scale: As Indicated

Armow Wind Power Project
 Tonal Assessment R221

Appendix B

Supplementary Wind Rose
 based on All Data

Appendix E

Calibration Certificates

Calibration Certificates –

Details are disclosed in the table below regarding the calibration of the equipment used for the I-Audit campaign at monitor location R221. The associated calibration certificates are provided in this appendix.

Location	Equipment	Make/Model	Serial Number	Date Calibrated [YYYY-MM-DD]
R221	Sound Level Meter	B&K 2250	3006579/ 3004506	2016-09-19/ 2017-08-15
	Microphone	B&K 4189	2919502/ 3036522	2016-09-19/ 2017-08-15
	Pre-Amplifier	B&K ZC 0032	21158/ 24551	2016-09-19/ 2017-08-15
	Weather Anemometer	Vaisala WXT 520	K0550007/ J4830029	2016-09-28/ 2016-01-11



SOH Wind Engineering LLC

141 Leroy Road • Williston, VT 05495 • USA

Tel 802.316.4368 • Fax 802.735.9106 • www.sohwind.com

CERTIFICATE FOR CALIBRATION OF CUP ANEMOMETER

Certificate number: 16.US1.00313

Date of issue: January 11, 2016

Type: Vaisala Weather Transmitter, WXT520

Serial number: J4830029.0deg

Manufacturer: VAISALA Oyj, PI 26, FIN-00421 Helsinki, Finland

Client: Aercooustics Engineering Ltd., 50 Ronson Dr, Suite 165, Toronto, ON M9W 1B3, Canada

Anemometer received: January 7, 2016

Anemometer calibrated: 11:45 January 11, 2016

Calibrated by: mej

Procedure: MEASNET, IEC 61400-12-1:2005(E) Annex F

Certificate prepared by: ejf

Approved by: Calibration engineer, rds

Calibration equation obtained: $v \text{ [m/s]} = 0.99409 \cdot f \text{ [m/s]} + 0.08374$

Robert D. Hard

Standard uncertainty, slope: 0.00140

Standard uncertainty, offset: 0.17665

Covariance: -0.0000193 (m/s)²/m/s



Coefficient of correlation: $\rho = 0.999989$

Absolute maximum deviation: 0.042 m/s at 12.905 m/s

Barometric pressure: 993.6 hPa

Relative humidity: 15.8%

Succession	Velocity pressure, q. [Pa]	Temperature in wind tunnel [°C]	d.p. box [°C]	Wind velocity, v. [m/s]	Anemometer Output, f. [m/s]	Deviation, d. [m/s]	Uncertainty u_c (k=2) [m/s]
2	10.59	24.1	27.5	4.268	4.200	0.009	0.050
4	15.00	24.1	27.5	5.079	5.039	-0.014	0.044
6	20.73	24.1	27.5	5.972	5.919	0.004	0.041
8	28.30	24.1	27.5	6.977	6.929	0.005	0.040
10	37.61	24.1	27.4	8.044	8.019	-0.011	0.040
12	47.28	24.1	27.5	9.019	8.990	-0.002	0.041
13-last	58.29	24.1	27.5	10.014	9.987	0.002	0.043
11	70.84	24.1	27.4	11.040	11.019	0.002	0.046
9	83.92	24.1	27.4	12.016	11.971	0.032	0.048
7	96.78	24.1	27.5	12.905	12.939	-0.042	0.051
5	113.00	24.1	27.5	13.944	13.935	0.007	0.054
3	131.27	24.1	27.5	15.030	15.016	0.019	0.057
1-first	147.04	24.0	27.5	15.906	15.929	-0.012	0.060

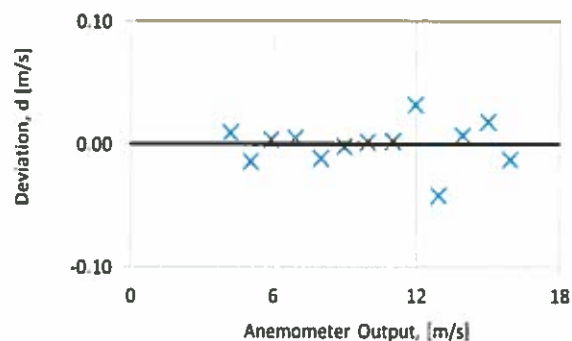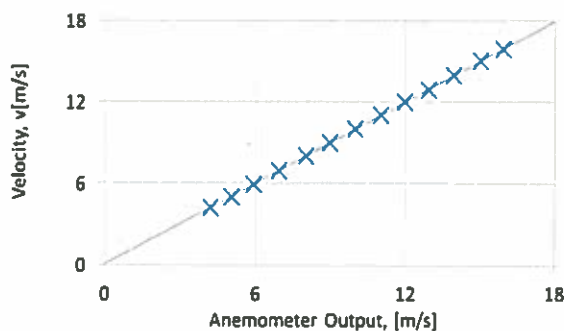

AC-1746



EQUIPMENT USED

Serial Number	Description
Njord 1	Wind tunnel, blockage factor = 1.004
2254	Control cup anemometer
-	Mounting tube, D = 30 mm
TT003	Summit RT-AUI, wind tunnel
TP001	Summit RT-AUI, differential pressure box
DP004	Setra Model 239 pressure transducer
HY003	Dwyer Instruments RHP-2D20 humidity transmitter
BP002	Setra Model 278 barometer
PL8	Pitot tube
XB002	Computer Board. 16 bit A/D data acquisition board
9PRZRWI	PC dedicated to data acquisition

Traceable calibrations of the equipment are carried out by external accredited institutions: Atlantic Scale, & Furness Controls. A real-time analysis module within the data acquisition software detects pulse frequency.

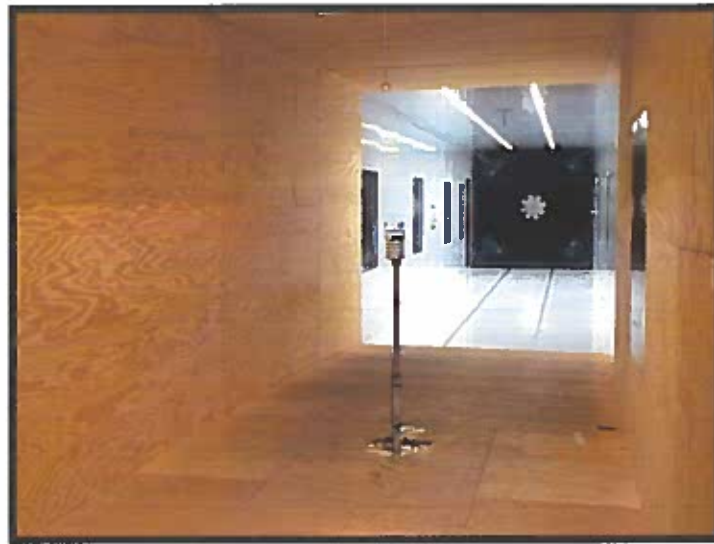


Photo of the wind tunnel setup. The cross-sectional area is 2.5 x 2.5 m.

UNCERTAINTIES

The documented uncertainty is the total combined uncertainty at 95% confidence level ($k=2$) in accordance with EA-4/02. The uncertainty at 10 m/s comply with the requirements in the IEC 61400-12-1:2005 procedure. See Document US.12.01.004 for further details.

Certificate number: 16.US1.00313



SOH Wind Engineering LLC

141 Leroy Road · Williston, VT 05495 · USA

Tel 802.316.4368 · Fax 802.735.9106 · www.sohwind.com

CERTIFICATE FOR CALIBRATION OF CUP ANEMOMETER

Certificate number: 16.US1.00314

Date of issue: January 11, 2016

Type: Vaisala Weather Transmitter, WXT520

Serial number: J4830029.90deg

Manufacturer: VAISALA Oyj, PI 26, FIN-00421 Helsinki, Finland

Client: Aercoustics Engineering Ltd., 50 Ronson Dr, Suite 165, Toronto, ON M9W 1B3, Canada

Anemometer received: January 7, 2016

Anemometer calibrated: 12:04 January 11, 2016

Calibrated by: mej

Procedure: MEASNET, IEC 61400-12-1:2005(E) Annex F

Certificate prepared by: ejf

Approved by: Calibration engineer, rds

Calibration equation obtained: $v \text{ [m/s]} = 0.99666 \cdot f \text{ [m/s]} + 0.12014$

Robert D. Hart

Standard uncertainty, slope: 0.00187

Standard uncertainty, offset: 0.16470

Covariance: -0.0000346 (m/s)²/m/s



Coefficient of correlation: $\rho = 0.999981$

Absolute maximum deviation: 0.046 m/s at 9.998 m/s

Barometric pressure: 993.6 hPa

Relative humidity: 15.6%

Succession	Velocity pressure, q. [Pa]	Temperature in wind tunnel [°C]	d.p. box [°C]	Wind velocity, v. [m/s]	Anemometer Output, f. [m/s]	Deviation, d. [m/s]	Uncertainty u_c (k=2) [m/s]
2	10.67	24.2	27.5	4.284	4.216	-0.038	0.050
4	15.05	24.2	27.5	5.089	4.997	-0.011	0.044
6	20.69	24.2	27.5	5.968	5.855	0.012	0.041
8	28.21	24.2	27.5	6.968	6.855	0.016	0.040
10	37.69	24.2	27.5	8.053	7.961	-0.002	0.040
12	47.46	24.2	27.5	9.037	8.916	0.031	0.041
13-last	58.09	24.2	27.5	9.998	9.865	0.046	0.043
11	70.53	24.2	27.5	11.018	10.932	0.002	0.046
9	83.85	24.2	27.5	12.013	11.945	-0.012	0.048
7	96.93	24.2	27.5	12.917	12.868	-0.028	0.051
5	113.10	24.2	27.5	13.954	13.906	-0.026	0.054
3	131.04	24.2	27.5	15.020	14.952	-0.002	0.057
1-first	147.08	24.1	27.5	15.912	15.832	0.013	0.060

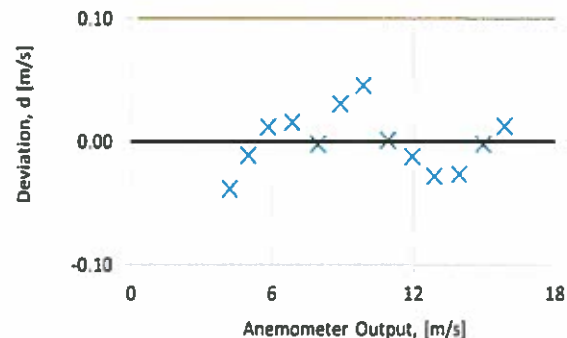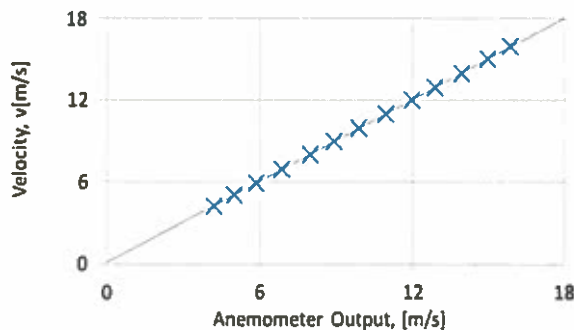

AC-1746



EQUIPMENT USED

Serial Number	Description
Njord 1	Wind tunnel, blockage factor = 1.004
2254	Control cup anemometer
-	Mounting tube, D = 30 mm
TT003	Summit RT-AUI, wind tunnel
TP001	Summit RT-AUI, differential pressure box
DP004	Setra Model 239 pressure transducer
HY003	Dwyer Instruments RHP-2D20 humidity transmitter
BP002	Setra Model 278 barometer
PL8	Pitot tube
XB002	Computer Board. 16 bit A/D data acquisition board
9PRZRW1	PC dedicated to data acquisition

Traceable calibrations of the equipment are carried out by external accredited institutions: Atlantic Scale, & Furness Controls. A real-time analysis module within the data acquisition software detects pulse frequency.

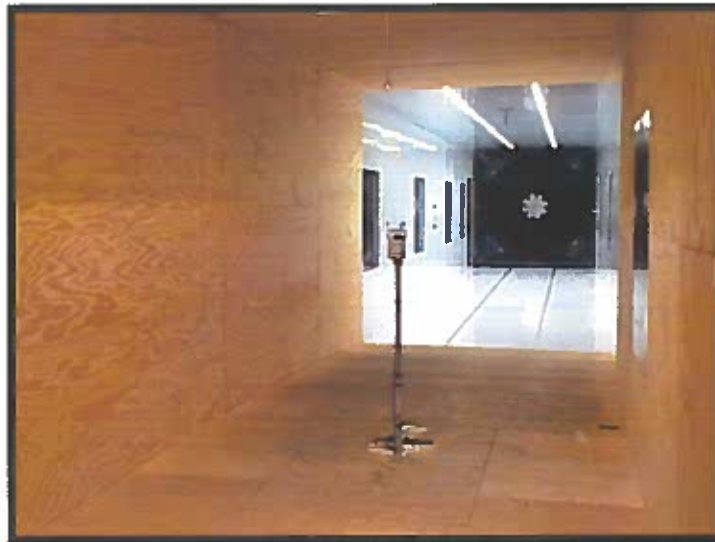


Photo of the wind tunnel setup. The cross-sectional area is 2.5 x 2.5 m.

UNCERTAINTIES

The documented uncertainty is the total combined uncertainty at 95% confidence level ($k=2$) in accordance with EA-4/02. The uncertainty at 10 m/s comply with the requirements in the IEC 61400-12-1:2005 procedure. See Document US.12.01.004 for further details.

Certificate number: 16.US1.00314

West Caldwell Calibration Laboratories Inc.

Certificate of Calibration

for

HAND-HELD ANALYZER

Manufactured by: **BRUEL & KJAER**
Model No: **2250**
Serial No: **3006579**
Calibration Recall No: **26857**

Submitted By:

Customer:

Company: **AERCOUSTICS ENGINEERING LTD.**
Address:

The subject instrument was calibrated to the indicated specification using standards traceable to the National Institute of Standards and Technology or to accepted values of natural physical constants. This document certifies that the instrument met the following specification upon its return to the submitter.

West Caldwell Calibration Laboratories Procedure No. **2250** **BRUE**

Upon receipt for Calibration, the instrument was found to be:

Within **(X)**

tolerance of the indicated specification. See attached Report of Calibration.

West Caldwell Calibration Laboratories' calibration control system meets the requirements, ISO 10012-1 MIL-STD-45662A, ANSI/NCSL Z540-1, IEC Guide 25, ISO 9001:2008 and ISO 17025.

Note: With this Certificate, Report of Calibration is included.

Approved by:

Calibration Date: **19-Sep-16**

Certificate No: **26857 - 1**

QA Doc. #1051 Rev. 2.0 10/1/01

Certificate Page 1 of 1

FC
Felix Christopher (QA Mgr.)
ISO/IEC 17025:2005

**West Caldwell
Calibration
Laboratories, Inc.**
uncompromised calibration
1575 State Route 96, Victor, NY 14564, U.S.A.



Calibration Lab. Cert. # 1533.01



1575 State Route 96, Victor NY 14564

ISO/IEC 17025: 2005



Calibration Lab. Cert. # 1533.01

REPORT OF CALIBRATION

for

Brüel & Kjær Hand-held Analyzer
Company: Aercoustics Engineering Ltd

Model No.: 2250

Serial No.: 3006579
ID No.: XXXX

The procedure from IEC 61672-3-2013 were used to perform the periodic test. (Test limits are from IEC 61672-1-2013)
Instrument submitted for testing has successfully completed the Class 1 periodic test of IEC 61672-3-2013 listed below.
Also meets the requirements of ANSI/ASA S1.4 - 2014 / Part 3.
Fulfills 1/1-Octave and 1/3-Octave Filter ANSI/ASA S1.11 -1-2004 and IEC61260-1 : 2014 requirements.

Absolute Acoustical Sensitivity Level, IEC 61672 - 3 (9)	Pass
Electrical Inherent Noise Level, Freq. Weig. Lin, IEC 61672-3 (10)	Pass
Determining Electrical Level for 1V at 1kHz	Pass
Frequency Response measured with Electrical Signal, Freq. Weig. A with HP filter, IEC 61672 Class 1 (12)	Pass
Frequency Response measured with Electrical Signal, Freq. Weig. C with HP filter, IEC 61672 Class 1 (12)	Pass
Frequency Response measured with Electrical Signal, Freq. Weig. Z with HP filter, IEC 61672 Class 1 (12)	Pass
Frequency Weightings at A - Weighting 1kHz, IEC 61672-3 (13)	Pass
Frequency Weightings at C - Weighting 1kHz, IEC 61672-3 (13)	Pass
Frequency Weightings at Z - Weighting 1kHz, IEC 61672-3 (13)	Pass
Linearity Range at 1kHz, IEC61672 - 3 (14)	Pass
Range Level at 1kHz, IEC61672 - 3 (15)	Pass
Time Weighting Response to Single Burst, 4kHz, 200ms, F Class 1, IEC61672 - 3 (16)	Pass
Time Weighting Response to Single Burst, 4kHz, 2ms, F Class 1, IEC61672 - 3 (16)	Pass
Time Weighting Response to Single Burst, 4kHz, 0.25ms, F Class 1, IEC61672 - 3 (16)	Pass
Time Weighting Response to Single Burst, 4kHz, 200ms, S Class 1, IEC61672 - 3 (16)	Pass
Time Weighting Response to Single Burst, 4kHz, 2ms, S Class 1, IEC61672 - 3 (16)	Pass
Peak C Level 8kHz Sine IEC 61672 - 3 Class 1 (17)	Pass
Peak C Level 500Hz Positive Pulse IEC 61672 - 3 Class 1 (17)	Pass
Peak C Level 500Hz Negative Pulse IEC 61672 - 3 Class 1 (17)	Pass
Overload Indication IEC 61672 - 3 (18)	Pass
Octave and 1/3 Octave level IEC 61260 - 5.3	Pass

Measurements performed by: 

Kent Zeng

Calibrated on WCCL system type 9700

This document shall not be reproduced, except in full, without the written approval from West Caldwell Cal. Labs. Inc.

Rev. 7.0 Jan. 24, 2014 Doc. # 10382250B&K

Calibration results:

Before & After data: ...X...

All Tests: Pass
 Sensitivity: Pass
 Frequency Response: Pass
 Lin Response: Pass
 C weighting: Pass
 A weighting: Pass
 1dB steps: Pass
 Linearity: Pass
 Noise: Pass
 Random signal: Pass
 Time Constant: Pass
 Function: Pass
 Filter: Pass

Laboratory Environment:

Ambient Temperature: 21.3 °C
 Ambient Humidity: 50.9 % RH
 Ambient Pressure: 99.462 kPa
 Calibration Date: 19-Sep-2016
 Calibration Due: 19-Sep-2017
 Report Number: 26857 -1
 Control Number: 26857

The above listed instrument meets or exceeds the tested manufacturer's specifications.

IEC 61672-1:2002 Class 1, IEC 61260:1995 w.Am.1, 1/1 and 1/3 Oct. Band Class 0 specification passed.

IEC 60804:2000 Type 1, IEC 60651:1979 w.Am.1&2 Type 1 specification passed.


IEC 61672-1:2002 Class 1 specification passed.

IEC 60804:2000 Type 1 specification passed.

This Calibration is traceable through NIST test numbers: 683/284413-14

The absolute uncertainty of calibration: See last page. Unless otherwise noted, the reported values are both "as found" and "as left" data.

The curve is the response recorded with electrical input with 50pF (1V=120dB).

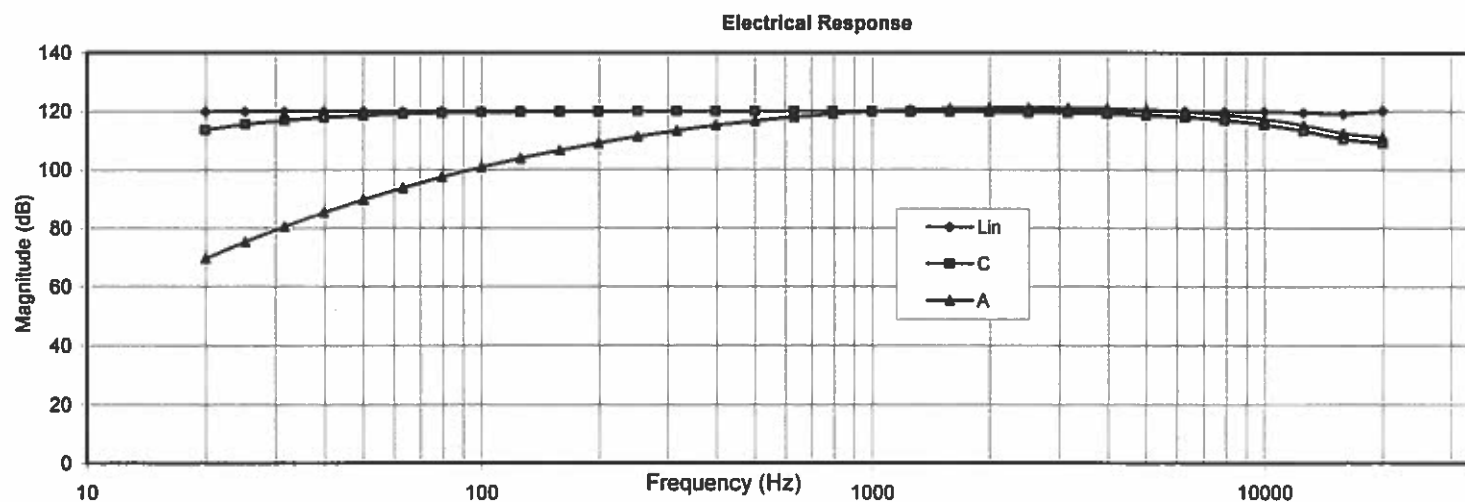

The above listed instrument was checked using calibration procedure documented in West Caldwell

Calibration Laboratories Inc. procedure :

Rev. 7.0 Jan. 24, 2014 Doc. # 1038 2250B&K

Calibration was performed by West Caldwell Calibration Laboratories Inc. under Operating Procedures

intended to implement the requirements of ISO10012-1, IEC Guide 25, ANSI/NC SL Z540-1, (MIL-STD-45662A) and ISO 9001:2008, ISO 17025

West Caldwell Calibration Laboratories Inc.

1575 State Route 96, Victor NY 14564
Tel. (585) 586-3900 FAX (585) 586-4327

Calibration Data Record

for

Brüel & Kjær Hand-held Analyzer

Model No.: 2250

Serial No.: 3006579

Mic. Model No.: 4189

Serial No.: 2919502

Company: Aercooustics Engineering Ltd

Frequency Response (Reference = 94 dB @ 1000Hz)

Frequency (Hz)	Weighting		
	Z	C	A
19.95	119.9	113.7	69.6
25.12	120.1	115.7	75.4
31.62	120.0	116.9	80.5
39.81	120.0	118.0	85.4
50.12	120.1	118.7	89.7
63.1	120.0	119.1	93.8
79.43	120.0	119.5	97.5
100	120.0	119.7	100.9
125.89	120.0	119.8	103.9
158.49	120.0	119.9	106.7
199.53	120.0	120.0	109.1
251.19	120.0	120.0	111.4
316.23	120.0	120.0	113.4
398.11	120.0	120.0	115.2
501.19	120.0	120.0	116.8
630.96	120.0	120.0	118.1

Frequency (Hz)	Weighting		
	Z	C	A
794.33	120.0	120.0	119.2
1000	120.0	120.0	120.0
1258.93	120.0	120.0	120.6
1584.89	120.0	119.9	121.0
1995.26	120.0	119.8	121.2
2511.89	120.0	119.7	121.3
3162.28	120.0	119.5	121.2
3981.07	120.0	119.2	121.0
5011.87	120.0	118.7	120.6
6309.57	120.0	118.0	119.9
7943.28	120.0	117.0	118.9
10000	119.9	115.5	117.4
12589.25	119.6	113.3	115.2
15848.93	119.1	110.6	112.5
19952.62	120.3	109.1	111.1

Frequency Weightings at A - Weighting 1kHz, IEC 61672-3 (13)

Frequency Weightings at C - Weighting 1kHz, IEC 61672-3 (13)

Frequency Weightings at Z - Weighting 1kHz, IEC 61672-3 (13)

ANSI/ASA S1.4 - 2014 / Part 3 -13

Instruments used for calibration:			Date of Cal.	Traceability No.	Cal. Due Date
Brüel & Kjær	4134	S/N 1942286	1-Oct-2015	683/284413-14	1-Oct-2016
Brüel & Kjær	4226	S/N 1445428	10-Nov-2015	683/284413-14	10-Nov-2016
HP	34401A	S/N 36064102	1-Oct-2015	,287708	1-Oct-2016
HP	33120A	S/N 36043716	1-Oct-2015	,287708	1-Oct-2016

Cal. Date: 19-Sep-2016

Tested by: Kent Zeng

Calibrated on WCCL system type 9700

This document shall not be reproduced except in full without the written approval from West Caldwell Cal. Labs. Inc.

Rev. 7.0 Jan. 24, 2014 Doc. # 10382250B&K

West Caldwell Calibration Laboratories Inc.

1575 State Route 96, Victor NY 14564
Tel. (585) 586-3900 FAX (585) 586-4327

Calibration Data Record

for

Brüel & Kjær Hand-held Analyzer
Company: Aercoustics Engineering Ltd

Model No.: 2250

Serial No.: 3006579

ID No.: XXXX

Level Accuracy (Reference = 120 dB @ 1000Hz)

Nom. Value	Meas. Value	Tolerance Limits	Dev. in the last 1 dB	Deviation Rel. to 94.0 dB
[dB]	[dB]	[dB]	[dB]	[dB]
135.0	135.0	0.5	0.0	0.1
134.0	134.0	0.5	0.0	0.1
133.0	133.0	0.5	0.0	0.1
132.0	132.0	0.5	0.0	0.1
131.0	131.0	0.5	0.0	0.0
130.0	130.0	0.5	0.0	0.0
129.0	129.0	0.5	0.0	0.0
128.0	128.0	0.5	0.0	0.0
127.0	127.0	0.5	0.0	0.0
126.0	126.0	0.5	0.0	0.0
125.0	125.0	0.5	0.0	0.0
124.0	124.0	0.5	0.0	0.0
123.0	123.0	0.5	0.0	0.0
122.0	122.0	0.5	0.0	0.0
121.0	121.0	0.5	0.0	0.0
120.0	120.0	0.5	0.0	0.0
119.0	119.0	0.5	0.0	0.0
118.0	118.0	0.5	0.0	0.0
117.0	117.0	0.5	0.0	0.0
116.0	116.0	0.5	0.0	0.0
115.0	115.0	0.5	0.0	0.0
114.0	114.0	0.5	0.0	0.0
113.0	113.0	0.5	0.0	0.0
112.0	112.0	0.5	0.0	0.0
111.0	111.0	0.5	0.0	0.0
110.0	110.0	0.5	0.0	0.0
109.0	109.0	0.5	0.0	0.0
108.0	108.0	0.5	0.0	0.0
107.0	107.0	0.5	0.0	0.0
106.0	106.0	0.5	0.0	0.0
105.0	105.0	0.5	0.0	0.0
104.0	104.0	0.5	0.0	0.0
103.0	103.0	0.5	0.0	0.0
102.0	102.0	0.5	0.0	0.0
101.0	101.0	0.5	0.0	0.0
100.0	100.0	0.5	0.0	0.0
99.0	99.0	0.5	0.0	0.0
98.0	98.0	0.5	0.0	0.0
97.0	97.0	0.5	0.0	0.0
96.0	96.0	0.5	0.0	0.0
95.0	95.0	0.5	0.0	0.0
94.0	94.0	0.5	0.0	0.0
93.0	93.0	0.5	0.0	0.0
92.0	92.0	0.5	0.0	0.0
91.0	91.0	0.5	0.0	0.0
90.0	90.0	0.5	0.0	0.0
89.0	89.0	0.5	0.0	0.0
88.0	88.0	0.5	0.0	0.0
87.0	87.0	0.5	0.0	0.0
86.0	86.0	0.5	0.0	0.0

Nom. Value	Meas. Value	Tolerance Limits	Dev. in the last 1 dB	Deviation Rel. to 94.0 dB
[dB]	[dB]	[dB]	[dB]	[dB]
85.0	85.0	0.5	0.0	0.0
84.0	84.0	0.5	0.0	0.0
83.0	83.0	0.5	0.0	0.0
82.0	82.0	0.5	0.0	0.0
81.0	81.0	0.5	0.0	0.0
80.0	80.0	0.5	0.0	0.0
79.0	79.0	0.5	0.0	0.0
78.0	78.0	0.5	0.0	0.0
77.0	77.0	0.5	0.0	0.0
76.0	76.0	0.5	0.0	0.0
75.0	75.0	0.5	0.0	0.0
74.0	74.0	0.5	0.0	0.0
73.0	73.0	0.5	0.0	0.0
72.0	72.0	0.5	0.0	0.0
71.0	71.0	0.5	0.0	0.0
70.0	70.0	0.5	0.0	0.0
69.0	69.0	0.5	0.0	0.0
68.0	68.0	0.5	0.0	0.0
67.0	67.0	0.5	0.0	0.0
66.0	66.0	0.5	0.0	0.0
65.0	65.0	0.5	0.0	0.0
64.0	64.0	0.5	0.0	0.0
63.0	63.0	0.5	0.0	0.0
62.0	62.0	0.5	0.0	0.0
61.0	61.0	0.5	0.0	0.0
60.0	60.0	0.5	0.0	0.0
59.0	59.0	0.5	0.0	0.0
58.0	58.0	0.5	0.0	0.0
57.0	57.0	0.5	0.0	0.0
56.0	56.0	0.5	0.0	0.0
55.0	55.0	0.5	0.0	0.0
54.0	54.0	0.5	0.0	0.0
53.0	53.0	0.5	0.0	0.0
52.0	52.0	0.5	0.0	0.0
51.0	51.0	0.5	0.0	0.0
50.0	50.0	0.5	0.0	0.0
49.0	49.0	0.5	0.0	0.0
48.0	48.0	0.5	0.0	0.0
47.0	47.0	0.5	0.0	0.0
46.0	46.0	0.5	0.0	0.0
45.0	45.0	0.5	0.0	0.0
44.0	44.0	0.5	0.0	0.0
43.0	43.0	0.5	0.0	0.0
42.0	42.0	0.5	0.0	0.0
41.0	41.0	0.5	0.0	0.0
40.0	40.0	0.5	0.0	0.0
39.0	39.0	0.5	0.0	0.0
38.0	38.0	0.5	0.0	0.0
37.0	37.0	0.5	0.0	0.0
36.0	36.0	0.5	0.0	0.0

Linearity Range at 1kHz, IEC61672 - 3 (14)

ANSI/ASA S1.4 - 2014 / Part 3 - 17

This document shall not be reproduced, except in full, without the written approval from West Caldwell Cal. Labs. Inc.

Rev. 7.0 Jan. 24, 2014 Doc. # 10382250B&K

Test Function	Tolerance		Value	Measured values	
	Min	Max			Out
0. Reading with 94.0dB SPL dB Absolute Acoustical Sensitivity Level, IEC 61672 - 3 (9) ANSI/ASA S1.4 - 2014 / Part 3. -10	93.7	94.3	94	93.9	
0. Determining Electrical Level for 1V at 1kHz	119.7	120.3	120	120.0	
1. Attenuator accuracy Linearity Range at 1kHz, IEC61672 - 3 (14) ANSI/ASA S1.4 - 2014 / Part 3 - 17			FSD (dB)		
	34.6	35.4	35	35.0	
	39.6	40.4	40	40.0	
	44.6	45.4	45	45.0	
	49.6	50.4	50	50.0	
	54.6	55.4	55	55.0	
	59.6	60.4	60	60.0	
	64.6	65.4	65	65.0	
	69.6	70.4	70	70.0	
	74.6	75.4	75	75.0	
	79.6	80.4	80	80.0	
	84.6	85.4	85	85.0	
	89.6	90.4	90	90.0	
	94.6	95.4	95	95.0	
	99.6	100.4	100	100.0	
	104.6	105.4	105	105.0	
	109.6	110.4	110	110.0	
	114.6	115.4	115	115.0	
	119.6	120.4	120	120.0	
	124.6	125.4	125	125.0	
	129.6	130.4	130	130.0	
	134.6	135.4	135	135.0	
2. Frequency Response with mic. A Weighting Ref. 94.0 dB @ 1kHz Frequency Weightings at A - Weighting 1kHz, IEC 61672-3 (13) ANSI/ASA S1.4 - 2014 / Part 3 -12			(Hz)		
	53.3	55.9	31.5	55.4	
	67.0	68.6	63	67.9	
	77.1	78.7	125	77.9	
	84.6	86.2	250	85.3	
	90.0	91.6	500	90.7	
	93.2	94.8	1000	94.0	
	94.4	96.0	2000	95.3	
	94.2	95.8	4000	95.2	
	90.1	94.2	8000	92.7	
	83.9	92.5	12500	89.1	
	0.0	90.2	16000	87.2	
C Weighting Frequency Weightings at C - Weighting 1kHz, IEC 61672-3 (13) ANSI/ASA S1.4 - 2014 / Part 3 -12			(Hz)		
	89.7	92.3	31.5	90.9	
	92.4	94.0	63	93.2	
	93.0	94.6	125	93.8	
	93.2	94.8	250	94.0	
	93.2	94.8	500	94.0	
	93.2	94.8	1000	94.0	
	93.0	94.6	2000	94.0	
	92.4	94.0	4000	93.4	
	88.2	92.3	8000	90.9	
	82.0	90.6	12500	87.5	
	0.0	88.3	16000	86.0	

Test Function	Tolerance		Value	Measured values	
	Min	Max			Out
Z Weighting	92.7	95.3	(Hz) 31.5	94.0	
Frequency Weightings at Z - Weighting 1kHz, IEC 61672-3 (13)	93.2	94.8	63	94.1	
ANSI/ASA S1.4 - 2014 / Part 3 -12	93.2	94.8	125	94.1	
	93.2	94.8	250	94.0	
	93.2	94.8	500	94.0	
	93.2	94.8	1000	94.0	
	93.2	94.8	2000	94.2	
	93.2	94.8	4000	94.2	
	91.2	95.3	8000	93.9	
	88.2	96.8	12500	93.6	
	0.0	96.8	16000	94.0	
Frequency Response with Electrical Signal			(Hz)		
A Weighting	67.1	71.9	20.0	69.6	
Ref. 94.0 dB @ 1kHz	73.4	77.2	25.1	75.4	
Frequency Response measured with Electrical Signal,	79.2	82.0	31.6	80.5	
Freq. Weig. A with HP filter, IEC 61672 Class 1 (12)	84.0	86.8	39.8	85.4	
ANSI/ASA S1.4 - 2014 / Part 3 -13	88.9	90.7	50.1	89.7	
	92.9	94.7	63.1	93.8	
	96.6	98.4	79.4	97.5	
	100.0	101.8	100.0	100.9	
	103.0	104.8	125.9	103.9	
	105.7	107.5	158.5	106.7	
	108.2	110.0	199.5	109.1	
	110.5	112.3	251.2	111.4	
	112.5	114.3	316.2	113.4	
	114.3	116.1	398.1	115.2	
	115.9	117.7	501.2	116.8	
	117.2	119.0	631.0	118.1	
	118.3	120.1	794.3	119.2	
	119.1	120.9	1000.0	120.0	
	119.7	121.5	1258.9	120.6	
	120.1	121.9	1584.9	121.0	
	120.3	122.1	1995.3	121.2	
	120.3	122.2	2511.9	121.3	
	120.3	122.1	3162.3	121.2	
	120.1	121.9	3981.1	121.0	
	119.6	121.9	5011.9	120.6	
	118.0	121.3	6309.6	119.9	
	116.0	120.3	7943.3	118.9	
	113.6	119.4	10000.0	117.4	
	109.8	118.6	12589.3	116.2	
	112.1	116.3	15848.9	112.6	
	0.0	113.6	19952.6	111.1	

Test Function	Tolerance		Value	Measured values	
	Min	Max			Out
			(Hz)		
C Weighting	111.4	116.2	20.0	113.7	
Frequency Response measured with Electrical Signal,	113.7	117.5	25.1	115.7	
Freq. Weig. C with HP filter, IEC 61672 Class 1 (12)	115.6	118.4	31.6	116.9	
ANSI/ASA S1.4 - 2014 / Part 3 -13	116.6	119.4	39.8	118.0	
	117.8	119.6	50.1	118.7	
	118.3	120.1	63.1	119.1	
	118.6	120.4	79.4	119.5	
	118.8	120.6	100.0	119.7	
	118.9	120.7	125.9	119.8	
	119.0	120.8	158.5	119.9	
	119.1	120.9	199.5	120.0	
	119.1	120.9	251.2	120.0	
	119.1	120.9	316.2	120.0	
	119.1	120.9	398.1	120.0	
	119.1	120.9	501.2	120.0	
	119.1	120.9	631.0	120.0	
	119.1	120.9	794.3	120.0	
	119.1	120.9	1000.0	120.0	
	119.1	120.9	1258.9	120.0	
	119.0	120.8	1584.9	119.9	
	118.9	120.7	1995.3	119.8	
	118.8	120.6	2511.9	119.7	
	118.6	120.4	3162.3	119.5	
	118.3	120.1	3981.1	119.2	
	117.8	120.1	5011.9	118.7	
	116.1	119.4	6309.6	118.0	
	114.1	118.4	7943.3	117.0	
	111.7	117.5	10000.0	115.5	
	107.9	116.7	12589.3	113.3	
	110.1	114.4	15848.9	110.6	
	105.1	111.7	19952.6	109.1	

Test Function	Tolerance		Value	Measured values	
	Min	Max			Out
Z Weighting	118.6	121.4	(Hz) 20.0	119.9	
Frequency Response measured with Electrical Signal,	118.6	121.4	25.1	120.1	
Freq. Weig. Z with HP filter, IEC 61672 Class 1 (12)	118.6	121.4	31.6	120.0	
ANSI/ASA S1.4 - 2014 / Part 3 -13	118.6	121.4	39.8	120.0	
	118.6	121.4	50.1	120.1	
	119.1	120.9	63.1	120.0	
	119.1	120.9	79.4	120.0	
	119.1	120.9	100.0	120.0	
	119.1	120.9	125.9	120.0	
	119.1	120.9	158.5	120.0	
	119.1	120.9	199.5	120.0	
	119.1	120.9	251.2	120.0	
	119.1	120.9	316.2	120.0	
	119.1	120.9	398.1	120.0	
	119.1	120.9	501.2	120.0	
	119.1	120.9	631.0	120.0	
	119.1	120.9	794.3	120.0	
	119.1	120.9	1000.0	120.0	
	119.1	120.9	1258.9	120.0	
	119.1	120.9	1584.9	120.0	
	119.1	120.9	1995.3	120.0	
	119.1	120.9	2511.9	120.0	
	119.1	120.9	3162.3	120.0	
	119.1	120.9	3981.1	120.0	
	117.1	121.4	5011.9	120.0	
	117.1	121.4	6309.6	120.0	
	117.1	121.4	7943.3	120.0	
	114.1	122.9	10000.0	119.9	
	114.1	122.9	12589.3	119.6	
	110.1	122.9	15848.9	119.1	
	110.1	122.9	19952.6	120.3	
4	Inherent noise level				
	Electrical Inherent Noise Level, Freq. Weig. Lin, IEC 61672-3 (10)				
	ANSI/ASA S1.4 - 2014 / Part 3 -11				
	Z Fast	less than 27		16.31	
	Z Slow	less than 20		15.97	
	Z Impulse	less than 30		15.68	
	Z Leq	less than 20		15.93	
	Z Peak	less than 32		25.25	
	Z Max	less than 32		16.87	
	C Fast	less than 27		12.97	
	C Slow	less than 20		12.77	
	C Impulse	less than 30		12.7	
	C Leq	less than 20		12.76	
	C Peak	less than 32		25.33	
	C Max	less than 32		12.99	
	A Fast	less than 27		12.83	
	A Slow	less than 20		12.76	
	A Impulse	less than 30		12.85	
	A Leq	less than 20		12.76	
	A Peak	less than 32		25.91	
	A Max	less than 32		12.79	

Test Function		Tolerance		Value	Measured values	
		Min	Max			Out
,5	Random signal	dB	dB			
	90 dB Test Level	89.6	90.4	Fast	90.2	
	Overload Indication IEC 61672 - 3 (18)	89.6	90.4	Slow	89.9	
	ANSI/ASA S1.4 - 2014 / Part 3 -20				140.0	
,6	Time Constant	dB	dB			
	90 dB 2kHz Test Level	88.1	89.4	Fast	89.0	
		84.1	87.9	Slow	86.1	
,7	Functions					
	ANSI/ASA S1.4 - 2014 / Part 3 -12					
	Z Fast	93.5	94.5	94.0	93.9	
	Z Slow	93.5	94.5	94.0	93.9	
	Z Impulse	93.5	94.5	94.0	93.9	
	Z Leq	93.5	94.5	94.0	93.9	
	Z Peak	96.0	98.0	97.0	97.6	
	Z Max	93.5	94.5	94.0	93.9	
	C Fast	93.5	94.5	94.0	93.9	
	C Slow	93.5	94.5	94.0	93.9	
	C Impulse	93.5	94.5	94.0	93.9	
	C Leq	93.5	94.5	94.0	93.9	
	C Peak	96.0	98.0	97.0	97.4	
	C Max	93.5	94.5	94.0	93.9	
	A Fast	93.5	94.5	94.0	93.9	
	A Slow	93.5	94.5	94.0	93.9	
	A Impulse	93.5	94.5	94.0	93.9	
	A Leq	93.5	94.5	94.0	93.9	
	A Peak	96.0	98.0	97.0	97.6	
	A Max	93.5	94.5	94.0	93.9	
	Peak C Level 8kHz Sine IEC 61672 - 3 Class 1 (17)	-5.4	-1.4	Peak	-2.1	
	Peak C Level 500Hz Positive Pulse IEC 61672 - 3 Class 1 (17)	-3.4	-1.4	Peak	-2.0	
	Peak C Level 500Hz Negative Pulse IEC 61672 - 3 Class 1 (17)	-3.4	-1.4	Peak	-2.0	
	Frequency Weightings at AFast - Weighting 1kHz, IEC 61672-3 (13)	93.6	94.4	94.0	94.0	
	Frequency Weightings at CFast - Weighting 1kHz, IEC 61672-3 (13)	93.6	94.4	94.0	94.0	
	Frequency Weightings at Z Fast- Weighting 1kHz, IEC 61672-3 (13)	93.6	94.4	94.0	94.0	
	Time Weighting Response to Single Burst, 4kHz, 200ms, F Class 1, IEC61672 - 3 (16)	-1.5	0.5		-1.0	
	Time Weighting Response to Single Burst, 4kHz, 2ms, F Class 1, IEC61672 - 3 (16)	-19.5	-17		-18.0	
	Time Weighting Response to Single Burst, 4kHz, 0.25ms, F Class 1, IEC61672 - 3 (16)	-30	-26		-27.2	
	Time Weighting Response to Single Burst, 4kHz, 200ms, S Class 1, IEC61672 - 3 (16)	-7.9	-6.4		-7.4	
	Time Weighting Response to Single Burst, 4kHz, 2ms, S Class 1, IEC61672 - 3 (16)	-27.5	-26.5		-27.0	
	ANSI/ASA S1.4 - 2014 / Part 3 - 18					
	Acoustic test at 4kHz.					
	A Weig.					
	A Fast	94.5	95.5	95.0	95.1	
	A Slow	94.5	95.5	95.0	95.1	
	A Impulse	94.5	95.5	95.0	95.1	
	A Leq	94.5	95.5	95.0	95.1	
	A Peak	97.0	99.0	98.0	98.2	
	A Max	94.5	95.5	95.0	95.1	

Test Function		1/3 Octave filter check			Out
Filter Hz		87.5 to 92.5	93.5 to 94.5	87.5 to 92.5	
12.5		90.4	94.0	90.3	
16		90.4	93.9	90.4	
20		90.3	94.0	90.3	
25.12		90.3	94.0	90.4	
31.62		90.3	94.0	90.5	
39.81		90.2	94.0	90.4	
50.12		90.3	94.0	90.4	
63.1		90.3	94.0	90.4	
79.43		90.3	94.0	90.4	
100		90.3	94.0	90.2	
125.89		90.5	94.0	90.3	
158.49		90.4	94.0	90.4	
199.53		90.3	94.0	90.3	
251.19		90.4	94.0	90.4	
316.23		90.3	94.0	90.5	
398.11		90.2	94.0	90.4	
501.19		90.3	94.0	90.4	
630.96		90.3	94.0	90.4	
794.33		90.3	94.0	90.4	
1000		90.3	94.0	90.2	
1258.93		90.5	94.0	90.3	
1584.89		90.4	94.0	90.4	
1995.26		90.3	94.0	90.3	
2511.89		90.4	94.0	90.4	
3162.28		90.3	94.0	90.5	
3981.07		90.3	94.0	90.4	
5011.87		90.4	94.0	90.4	
6309.57		90.3	94.0	90.4	
7943.28		90.3	94.0	90.4	
10000		90.3	93.9	90.0	
12589.25		90.2	93.6	89.6	
15848.93		89.7	93.6	89.8	
19952.62		89.7	94.0	91.1	

1/1-Octave and 1/3-Octave Filter Fulfils ANSI/ASA S1.11 -1-2004 and IEC61260-1 : 2014 specification.

1/1 Octave Filter Check					Out
Filter Hz		88.5 to 92.4	93.5 to 94.5	88.5 to 92.4	
16		90.4	94.0	90.3	
31.5		90.4	94.0	90.3	
63		90.4	94.0	90.3	
125		90.4	94.0	90.3	
250		90.4	93.9	90.3	
500		90.4	94.0	90.4	
1K		90.4	94.0	90.4	
2K		90.4	94.0	90.4	
4k		90.4	94.0	90.4	
8k		90.4	94.0	90.4	
16k		90.4	94.0	90.5	

The expanded uncertainty of calibration at 95% confidence level with a coverage factor of k=2.

Parameter	Test Instrumentation Uncertainty	DUT Uncertainty	Total DUT Uncertainty
Reading with mic. @ 1kHz:	0.071	0.1	0.12
Meter linearity:	0.011	0.1	0.10
Attenuator accuracy:	0.17	0.1	0.20
Freq. Response: 63Hz to 8kHz	0.094	0.1	0.14
Freq. Response: 12.5kHz & 16kHz	0.1	0.1	0.14
Electrical Freq. Resp.: 20Hz to 20kHz	0.024	0.1	0.10
Inherent noise level:	0.056	0.1	0.11
Crest Factor:	0.056	0.1	0.11
Time Constant:	0.056	0.1	0.11
Overload:	0.056	0.1	0.11
Functions:	0.09	0.1	0.13
Sensitivity:	0.13	0.1	0.16
1/3 & 1/1 Filters:	0.011	0.1	0.10

Cal. Date: 19-Sep-2016

Measurements By: Kent Zeng

Calibrated on WCCL system type 9700

This document shall not be reproduced, except in full, without the written approval from West Caldwell Cal. Labs. Inc.

Rev. 7.0 Jan. 24, 2014 Doc. # 10382250B&K

West Caldwell Calibration Laboratories Inc.

Certificate of Calibration

for

MICROPHONE

Manufactured by: **BRUEL & KJAER**
Model No: **4189**
Serial No: **2919502**
Calibration Recall No: **26857**

Submitted By:

Customer:
Company: **AERCOUSTICS ENGINEERING LTD.**
Address:

The subject instrument was calibrated to the indicated specification using standards traceable to the National Institute of Standards and Technology or to accepted values of natural physical constants. This document certifies that the instrument met the following specification upon its return to the submitter.

West Caldwell Calibration Laboratories Procedure No. **4189** **BRUE**

Upon receipt for Calibration, the instrument was found to be:

Within **(X)**

tolerance of the indicated specification. See attached Report of Calibration.

West Caldwell Calibration Laboratories' calibration control system meets the requirements, ISO 10012-1 MIL-STD-45662A, ANSI/NCSL Z540-1, IEC Guide 25, ISO 9001:2008 and ISO 17025.

Note: With this Certificate, Report of Calibration is included.

Approved by:

Calibration Date: **19-Sep-16**

Certificate No: **26857 - 2**

QA Doc. #1051 Rev. 2.0 10/1/01

Certificate Page 1 of 1

FC
Felix Christopher (QA Mgr.)
ISO/IEC 17025:2005

West Caldwell
Calibration
Laboratories, Inc.
uncompromised calibration
1575 State Route 96, Victor, NY 14564, U.S.A.



Calibration Lab. Cert. # 1533.01

**West Caldwell
Calibration
Laboratories, Inc.**
uncompromised calibration
1575 State Route 96, Victor NY 14564



Calibration Lab. Cert. # 1533.01

REPORT OF CALIBRATION

Brüel & Kjær Microphone

for
Model No.: 4189

Serial No.: 2919502

Company: Aercoustics Engineering Ltd

I. D. No.: XXXX

Calibration results:

Before & after data same: ...X...

Sensitivity @ 250 Hz and pressure of 99.46 kPa
0 Volts Polarization voltage (External):

-26.96 dB re.1V/Pascal

44.89 mV/Pascal

0.96 Ko (- dB re 50 mV/Pascal)

Sensitivity: Pass

Freq. Response: Pass

All tests: Pass

Ambient Temperature: 21.3 °C

Ambient Humidity: 50.9 % RH

Ambient Pressure: 99.462 kPa

Calibration Date: 19-Sep-2016

Re-calibration Due: 19-Sep-2017

Report Number: 26857 -2

Control Number: 26857

The above listed instrument meets or exceeds the tested manufacturer's specifications.


The IEC 651:1979 & 1993 Type 1 specification passed.

This Calibration is traceable through NIST test numbers: 683/284413-14

The expanded uncertainty of calibration: 0.094dB at 95% confidence level with a coverage factor of k=2.

The pressure response recorded with electroacoustic method.

Frequency Response

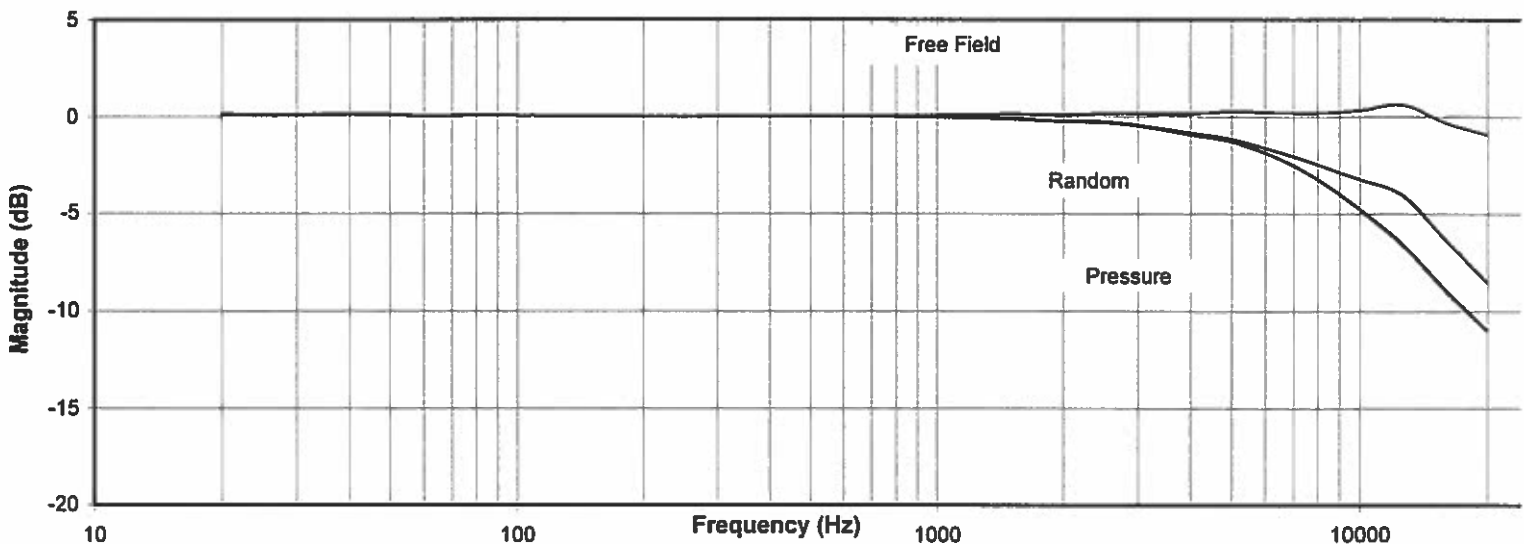

The above listed instrument was checked using calibration procedure documented in West Caldwell

Calibration Laboratories Inc. procedure :

Rev. 7.0 Jan. 24, 2014 Doc. # 1038 P4189B&K

Calibration was performed by West Caldwell Calibration Laboratories Inc. under Operating Procedures

intended to implement the requirements of ISO10012-1, IEC Guide 25, ANSI/NCSL Z540-1, (MIL-STD-45662A) and ISO 9001:2008, ISO 17025

Calibrated on WCCL system type 9700

This document shall not be reproduced, except in full, without the written approval from West Caldwell Cal. Labs. Inc.

Measurements performed by: Kent Zeng

Kent Zeng

Rev. 7.0 Jan. 24, 2014 Doc. # 1038 P4189B&K

West Caldwell Calibration Laboratories Inc.

1575 State Route 96, Victor NY 14564
Tel. (585) 586-3900 FAX (585) 586-4327

Calibration Data Record

Brüel & Kjær Microphone
Company: Aercoustics Engineering Ltd

for
Model No.: 4189

Serial No.: 2919502
I. D. No.: XXXX

Frequency Response (Reference = 0 dB @ 250Hz)

Frequency [Hz]	Pressure [dB]	Free Field (dB)	Random (dB)
19.95	0.15	0.15	0.15
25.12	0.11	0.11	0.11
31.62	0.11	0.11	0.11
39.81	0.14	0.14	0.14
50.12	0.11	0.11	0.11
63.10	0.04	0.04	0.04
79.43	0.09	0.09	0.09
100.00	0.06	0.06	0.06
125.89	0.04	0.04	0.04
158.49	0.02	0.02	0.02
199.53	0.02	0.02	0.02
251.19	0.00	0.00	0.00
316.23	0.04	0.04	0.04
398.11	0.00	0.01	0.00
501.19	0.03	0.05	0.03
630.96	0.00	0.04	0.00
794.33	0.01	0.07	0.01
1000.00	-0.01	0.09	-0.03
1258.93	-0.04	0.11	-0.07
1584.89	-0.10	0.12	-0.15
1995.26	-0.25	0.08	-0.25
2511.89	-0.31	0.17	-0.27
3162.28	-0.55	0.16	-0.52
3981.07	-0.92	0.14	-0.83
5011.87	-1.29	0.28	-1.15
6309.57	-2.07	0.21	-1.75
7943.28	-3.19	0.19	-2.44
10000.00	-4.77	0.35	-3.24
12589.25	-6.57	0.62	-4.06
15848.93	-8.89	-0.30	-6.30
19952.62	-10.97	-0.92	-8.49

Freq. response: Expanded Uncertainty (dB) with coverage factor K = 2

20 to 63 Hz 0.1dB, 63 to 12.5 kHz 0.094dB, 12.5k to 16kHz 0.10dB, 16k to 120kHz 0.5dB.

Instruments used for calibration:			Date of Cal.	Traceability No.	Re-cal. Due Date
Brüel & Kjær	4226	S/N 1445428	10-Nov-2015	683/284413-14	10-Nov-2016
Brüel & Kjær	3560	S/N 2202374	10-Nov-2015	683/284413-14	10-Nov-2016
HP	33120A	S/N 36043716	1-Oct-2015	,287708	1-Oct-2016
HP	34401A	S/N 36064102	1-Oct-2015	,287708	1-Oct-2016

Cal. Date: 19-Sep-2016

Tested by: Kent Zeng

Calibrated on WCCL system type 9700

This document shall not be reproduced except in full without the written approval from West Caldwell Cal. Labs. Inc.

Rev. 7.0 Jan. 24, 2014 Doc. # 1038 P4189B&K



SOH Wind Engineering LLC

141 Leroy Road · Williston, VT 05495 · USA

Tel 802.316.4368 · Fax 802.735.9106 · www.sohwind.com

CERTIFICATE FOR CALIBRATION OF SONIC ANEMOMETER

Certificate number: 16.US1.10500

Date of issue: September 28, 2016

Type: Vaisala Weather Transmitter, WXT520

Serial number: KD550007.90deg

Manufacturer: VAISALA Oyj, PL 26, FIN-00421 Helsinki, Finland

Client: Aercooustics Engineering Ltd., 50 Ronson Dr, Suite 165, Toronto, ON M9W 1B3, Canada

Anemometer received: September 27, 2016

Anemometer calibrated: 09:54 September 28, 2016

Calibrated by: mej

Procedure: MEASNET, IEC 61400-12-1:2005(E) Annex F

Certificate prepared by: Software Revision 7

Approved by: Calibration engineer, rds

Calibration equation obtained: $v [m/s] = 1.04997 \cdot f [m/s] + 0.06827$

Robert D. Hart

Standard uncertainty, slope: 0.00186

Standard uncertainty, offset: 0.28685

Covariance: $-0.0000371 (m/s)^2 / m/s$



Coefficient of correlation: $\rho = 0.999981$

Absolute maximum deviation: 0.059 m/s at 13.293 m/s

Barometric pressure: 1009.6 hPa

Relative humidity: 36.3%

Succession	Velocity pressure, q. [Pa]	Temperature in wind tunnel [°C]	d.p. box [°C]	Wind velocity, v. [m/s]	Anemometer Output, f. [m/s]	Deviation, d. [m/s]	Uncertainty $u_c (k=2)$ [m/s]
2	10.65	26.7	27.4	4.404	4.1448	-0.016	0.024
4	15.11	26.8	27.4	5.247	4.9034	0.031	0.025
6	20.79	26.8	27.4	6.155	5.8000	-0.003	0.027
8	28.23	26.8	27.4	7.173	6.7759	-0.010	0.030
10	37.66	26.7	27.4	8.285	7.8103	0.016	0.033
12	47.37	26.7	27.4	9.291	8.7828	0.001	0.036
13-last	58.25	26.7	27.3	10.303	9.7586	-0.011	0.039
11	70.73	26.7	27.4	11.353	10.7241	0.025	0.042
9	83.59	26.7	27.4	12.343	11.7069	-0.017	0.045
7	96.94	26.7	27.4	13.293	12.6517	-0.059	0.048
5	112.89	26.7	27.4	14.346	13.6000	-0.002	0.052
3	131.14	26.7	27.4	15.462	14.6379	0.025	0.055
1-first	147.27	26.7	27.4	16.385	15.5207	0.020	0.058

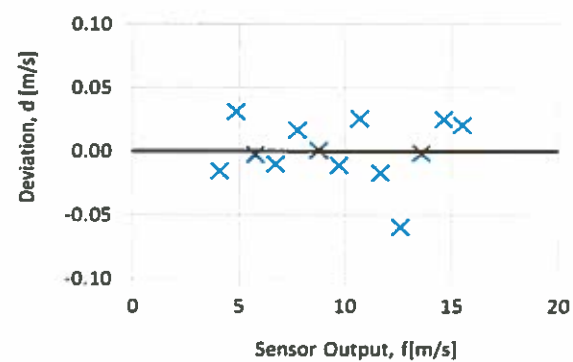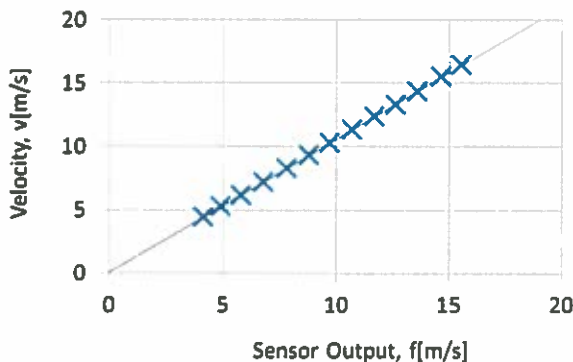

AC-1746



EQUIPMENT USED

Serial Number	Description
Njord 1	Wind tunnel, blockage factor = 1.004
2254	Control cup anemometer
-	Mounting tube, D = 30 mm
TT004	Summit RT-AUI, wind tunnel
TP001	Summit RT-AUI, differential pressure box
DP006	Setra Model 239 pressure transducer
HY001	Dwyer Instruments RHP-2D20 humidity transmitter
BP002	Setra Model 278 barometer
PL8	Pitot tube
XB002	Computer Board. 16 bit A/D data acquisition board
9PRZRW1	PC dedicated to data acquisition

Traceable calibrations of the equipment are carried out by external accredited institutions: Atlantic Scale, Essco Calibration Labs & Furness Controls. A real-time analysis module within the data acquisition software detects pulse frequency.



Photo of the wind tunnel setup. The cross-sectional area is 2.5 x 2.5 m.

UNCERTAINTIES

The documented uncertainty is the total combined uncertainty at 95% confidence level ($k=2$) in accordance with EA-4/02. The uncertainty at 10 m/s comply with the requirements in the IEC 61400-12-1:2005 procedure. See Document US.12.01.004 for further details.

Certificate number: 16.US1.10500



SOH Wind Engineering LLC

141 Leroy Road · Williston, VT 05495 · USA

Tel 802.316.4368 · Fax 802.735.9106 · www.sohwind.com

CERTIFICATE FOR CALIBRATION OF SONIC ANEMOMETER

Certificate number: 16.US1.10499

Date of issue: September 28, 2016

Type: Vaisala Weather Transmitter, WXT520

Serial number: KD550007.0deg

Manufacturer: VAISALA Oyj, PL 26, FIN-00421 Helsinki, Finland

Client: Aercooustics Engineering Ltd., 50 Ronson Dr, Suite 165, Toronto, ON M9W 1B3, Canada

Anemometer received: September 27, 2016

Anemometer calibrated: 09:34 September 28, 2016

Calibrated by: mej

Procedure: MEASNET, IEC 61400-12-1:2005(E) Annex F

Certificate prepared by: Software Revision 7

Approved by: Calibration engineer, rds

Calibration equation obtained: $v \text{ [m/s]} = 1.02722 \cdot f \text{ [m/s]} + -0.01865$

Standard uncertainty, slope: 0.00162

Standard uncertainty, offset: -0.92374

Covariance: $-0.0000279 \text{ (m/s)}^2 / \text{m/s}$



Coefficient of correlation: $\rho = 0.999986$

Absolute maximum deviation: 0.048 m/s at 16.380 m/s

Barometric pressure: 1009.6 hPa

Relative humidity: 36.4%

Succession	Velocity pressure, q, [Pa]	Temperature in wind tunnel [°C]	d.p. box [°C]	Wind velocity, v, [m/s]	Anemometer Output, f, [m/s]	Deviation, d, [m/s]	Uncertainty $u_c \text{ (k=2)}$ [m/s]
2	10.66	26.6	27.3	4.407	4.3034	0.005	0.024
4	15.12	26.7	27.3	5.249	5.1448	-0.018	0.025
6	20.72	26.7	27.3	6.144	5.9828	0.017	0.027
8	28.26	26.6	27.3	7.175	6.9828	0.021	0.030
10	37.62	26.6	27.3	8.278	8.0793	-0.002	0.033
12	47.51	26.6	27.4	9.303	9.0724	0.002	0.036
13-last	58.25	26.6	27.4	10.301	10.0448	0.002	0.039
11	70.67	26.6	27.4	11.347	11.1000	-0.036	0.042
9	83.73	26.6	27.3	12.352	12.0448	-0.002	0.045
7	96.96	26.6	27.3	13.293	12.9586	0.000	0.048
5	112.92	26.6	27.3	14.345	13.9966	-0.013	0.052
3	131.01	26.6	27.3	15.452	15.0828	-0.023	0.055
1-first	147.23	26.6	27.4	16.380	15.9172	0.048	0.058

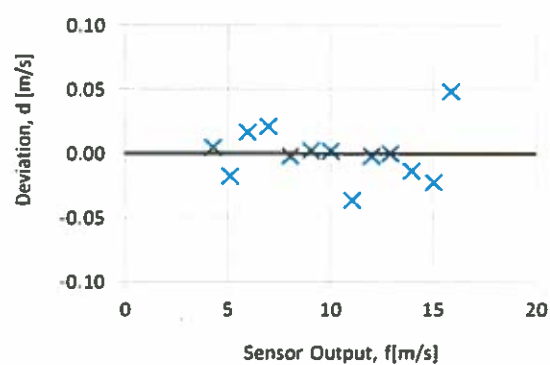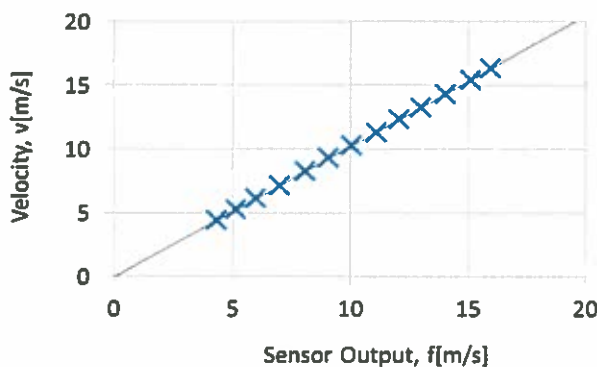

AC-1746



EQUIPMENT USED

Serial Number	Description
Njord 1	Wind tunnel, blockage factor = 1.004
2254	Control cup anemometer
-	Mounting tube, D = 30 mm
TT004	Summit RT-AUI, wind tunnel
TP001	Summit RT-AUI, differential pressure box
DP006	Setra Model 239 pressure transducer
HY001	Dwyer Instruments RHP-2D20 humidity transmitter
BP002	Setra Model 278 barometer
PL8	Pitot tube
XB002	Computer Board. 16 bit A/D data acquisition board
9PRZRW1	PC dedicated to data acquisition

Traceable calibrations of the equipment are carried out by external accredited institutions: Atlantic Scale, Essco Calibration Labs & Furness Controls. A real-time analysis module within the data acquisition software detects pulse frequency.



Photo of the wind tunnel setup. The cross-sectional area is 2.5 x 2.5 m.

UNCERTAINTIES

The documented uncertainty is the total combined uncertainty at 95% confidence level ($k=2$) in accordance with EA-4/02. The uncertainty at 10 m/s comply with the requirements in the IEC 61400-12-1:2005 procedure. See Document US.12.01.004 for further details.

Certificate number: 16.US1.10499

West Caldwell Calibration Laboratories Inc.

Certificate of Calibration

for

HAND HELD ANALYZER

Manufactured by: BRUEL & KJAER
Model No: 2250
Serial No: 3004506
Calibration Recall No: 27919

Submitted By:

Customer:
Company: Aercoustics Engineering Ltd.
Address:

The subject instrument was calibrated to the indicated specification using standards traceable to the National Institute of Standards and Technology or to accepted values of natural physical constants. This document certifies that the instrument met the following specification upon its return to the submitter.

West Caldwell Calibration Laboratories Procedure No. 2250 BRUE

Upon receipt for Calibration, the instrument was found to be:

Within (X)

tolerance of the indicated specification. See attached Report of Calibration.

West Caldwell Calibration Laboratories' calibration control system meets the requirements, ISO 10012-1 MIL-STD-45662A, ANSI/NCSL Z540-1, IEC Guide 25, ISO 9001:2008 and ISO 17025.

Note: With this Certificate, Report of Calibration is included.

Approved by:

FC

Calibration Date: 15-Aug-17

Felix Christopher (QA Mgr.)

Certificate No: 27919 - 11

QA Doc. #1061 Rev. 2.0 10/1/01

Certificate Page 1 of 1

ISO/IEC 17025:2005

**West Caldwell
Calibration
Laboratories, Inc.**
uncompromised calibration
1575 State Route 96, Victor, NY 14564, U.S.A.



Calibration Lab. Cert. # 1533.01



1575 State Route 96, Victor NY 14564



Calibration Lab. Cert. # 1533.01

REPORT OF CALIBRATION

for

Brüel & Kjær Hand-held Analyzer
Company: Aercoustics Engineering Ltd

Model No.: 2250

Serial No.: 3004506
ID No.: XXXX

The procedure from IEC 61672-3-2013 were used to perform the periodic test. (Test limits are from IEC 61672-1-2013)
Instrument submitted for testing has successfully completed the Class 1 periodic test of IEC 61672-3-2013 listed below.
Also meets the requirements of ANSI/ASA S1.4 - 2014 / Part 3.
Fulfills 1/1-Octave and 1/3-Octave Filter ANSI/ASA S1.11 -1-2004 and IEC61260-1 : 2014 requirements.

Absolute Acoustical Sensitivity Level, IEC 61672 - 3 (9)	Pass
Electrical Inherent Noise Level, Freq. Weig. Lin, IEC 61672-3 (10)	Pass
Determining Electrical Level for 1V at 1kHz	Pass
Frequency Response measured with Electrical Signal, Freq. Weig. A with HP filter, IEC 61672 Class 1 (12)	Pass
Frequency Response measured with Electrical Signal, Freq. Weig. C with HP filter, IEC 61672 Class 1 (12)	Pass
Frequency Response measured with Electrical Signal, Freq. Weig. Z with HP filter, IEC 61672 Class 1 (12)	Pass
Frequency Weightings at A - Weighting 1kHz, IEC 61672-3 (13)	Pass
Frequency Weightings at C - Weighting 1kHz, IEC 61672-3 (13)	Pass
Frequency Weightings at Z - Weighting 1kHz, IEC 61672-3 (13)	Pass
Linearity Range at 1kHz, IEC61672 - 3 (14)	Pass
Range Level at 1kHz, IEC61672 - 3 (15)	Pass
Time Weighting Response to Single Burst, 4kHz, 200ms, F Class 1, IEC61672 - 3 (16)	Pass
Time Weighting Response to Single Burst, 4kHz, 2ms, F Class 1, IEC61672 - 3 (16)	Pass
Time Weighting Response to Single Burst, 4kHz, 0.25ms, F Class 1, IEC61672 - 3 (16)	Pass
Time Weighting Response to Single Burst, 4kHz, 200ms, S Class 1, IEC61672 - 3 (16)	Pass
Time Weighting Response to Single Burst, 4kHz, 2ms, S Class 1, IEC61672 - 3 (16)	Pass
Peak C Level 8kHz Sine IEC 61672 - 3 Class 1 (17)	Pass
Peak C Level 500Hz Positive Pulse IEC 61672 - 3 Class 1 (17)	Pass
Peak C Level 500Hz Negative Pulse IEC 61672 - 3 Class 1 (17)	Pass
Overload Indication IEC 61672 - 3 (18)	Pass
Octave and 1/3 Octave level IEC 61260 - 5.3	Pass

Calibrated on WCCL system type 9700

This document shall not be reproduced, except in full, without the written approval from West Caldwell Cal. Labs. Inc.

Measurements performed by: **Kent Zeng**

Rev. 7.0 Jan. 24, 2014 Doc. # 1038 2250B&K

Calibration results:

Before & After data: ...X...

All Tests:	Pass
Sensitivity:	Pass
Frequency Response:	Pass
Lin Response:	Pass
C weighting:	Pass
A weighting:	Pass
1dB steps:	Pass
Linearity:	Pass
Noise:	Pass
Random signal:	Pass
Time Constant:	Pass
Function:	Pass
Filter:	Pass

Laboratory Environment:

Ambient Temperature:	22.3	°C
Ambient Humidity:	52.6	% RH
Ambient Pressure:	98.883	kPa
Calibration Date:	15-Aug-2017	
Calibration Due:	15-Aug-2019	
Report Number:	27919 -11	
Control Number:	27919	

The above listed instrument meets or exceeds the tested manufacturer's specifications.

IEC 61672-1:2002 Class 1, IEC 61260:1995 w.Am.1, 1/1 and 1/3 Oct. Band Class 0 specification passed.

IEC 60804:2000 Type 1, IEC 60651:1979 w.Am.1&2 Type 1 specification passed.


IEC 61672-1:2002 Class 1 specification passed.

IEC 60804:2000 Type 1 specification passed.

This Calibration is traceable through NIST test numbers: 822/275722-14

The absolute uncertainty of calibration: See last page. Unless otherwise noted, the reported values are both "as found" and "as left" data.

The curve is the response recorded with electrical input with 50pF (1V=120dB).

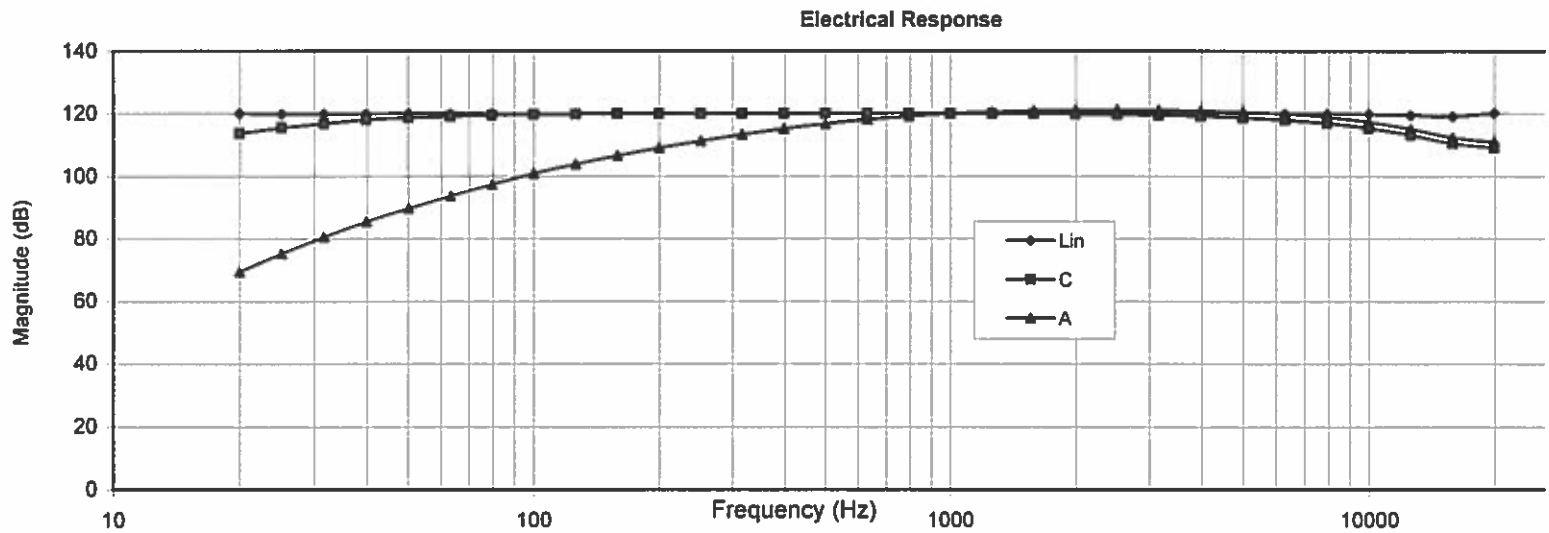

The above listed instrument was checked using calibration procedure documented in West Caldwell

Calibration Laboratories Inc. procedure :

Rev. 7.0 Jan. 24, 2014 Doc. # 1038 2250B&K

Calibration was performed by West Caldwell Calibration Laboratories Inc. under Operating Procedures

intended to implement the requirements of ISO10012-1, IEC Guide 25, ANSI/NCSL Z540-1, (MIL-STD-45662A) and ISO 9001:2008, ISO 17025

West Caldwell Calibration Laboratories Inc.

1575 State Route 96, Victor NY 14564
Tel. (585) 586-3900 FAX (585) 586-4327

Calibration Data Record

for

Brüel & Kjær Hand-held Analyzer

Model No.: 2250

Serial No.: 3004506

Mic Model No.: 4189

Serial No.: 3036522

Preamp Model No.: ZC0032

Serial No.: 24551

Company: Aercoustics Engineering Ltd

Frequency Response (Reference = 94 dB @ 1000Hz)

Frequency (Hz)	Weighting		
	Z	C	A
19.95	120.1	113.8	69.4
25.12	120.0	115.6	75.2
31.62	120.0	116.9	80.5
39.81	119.9	118.1	85.4
50.12	120.0	118.7	89.8
63.1	120.0	119.1	93.8
79.43	120.0	119.5	97.5
100	120.0	119.7	100.9
125.89	120.0	119.8	103.9
158.49	120.0	119.9	106.7
199.53	120.0	120.0	109.1
251.19	120.0	120.0	111.4
316.23	120.0	120.0	113.4
398.11	120.0	120.0	115.2
501.19	120.0	120.0	116.8
630.96	120.0	120.0	118.1

Frequency (Hz)	Weighting		
	Z	C	A
794.33	120.0	120.0	119.2
1000	120.0	120.0	120.0
1258.93	120.0	120.0	120.6
1584.89	120.0	119.9	121.0
1995.26	120.0	119.8	121.2
2511.89	120.0	119.7	121.3
3162.28	120.0	119.5	121.2
3981.07	120.0	119.2	121.0
5011.87	120.0	118.7	120.6
6309.57	120.0	118.0	119.9
7943.28	120.0	117.0	118.9
10000	119.9	115.5	117.4
12589.25	119.6	113.3	115.2
15848.93	119.1	110.6	112.5
19952.62	120.2	109.2	111.1

Frequency Weightings at A - Weighting 1kHz, IEC 61672-3 (13)

Frequency Weightings at C - Weighting 1kHz, IEC 61672-3 (13)

Frequency Weightings at Z - Weighting 1kHz, IEC 61672-3 (13)

ANSI/ASA S1.4 - 2014 / Part 3 -13

Instruments used for calibration:			Date of Cal.	Traceability No.	Cal. Due Date
Brüel & Kjær	4134	S/N 854464	1-Oct-2016	822/275722-14	1-Oct-2017
Brüel & Kjær	4226	S/N 2272364	11-Jul-2017	822/275722-15	11-Jul-2018
HP	34401A	S/N US360980	5-Oct-2016	,205342	5-Oct-2017
HP	33120A	S/N US360458	6-Oct-2016	,205342	6-Oct-2017

Cal. Date: 15-Aug-2017

Tested by: Kent Zeng

Calibrated on WCCL system type 9700

This document shall not be reproduced except in full without the written approval from West Caldwell Cal. Labs. Inc.

Rev. 7.0 Jan. 24, 2014 Doc. # 1038 2250B&K

West Caldwell Calibration Laboratories Inc.

1575 State Route 96, Victor NY 14564

Tel. (585) 586-3900 FAX (585) 586-4327

Calibration Data Record

for

Model No.: 2250

Serial No.: 3004506

Brüel & Kjær Hand-held Analyzer

Company: Aercoustics Engineering Ltd

ID No.: XXXX

Level Accuracy (Reference = 120 dB @ 1000Hz)

Nom. Value	Meas. Value	Tolerance Limits	Dev. In the last 1 dB	Deviation Rel. to 94.0 dB
[dB]	[dB]	[dB]	[dB]	[dB]
135.0	135.0	0.5	0.0	0.0
134.0	134.0	0.5	0.0	0.0
133.0	133.0	0.5	0.0	0.0
132.0	132.0	0.5	0.0	0.0
131.0	131.0	0.5	0.0	0.0
130.0	130.0	0.5	0.0	0.0
129.0	129.0	0.5	0.0	0.0
128.0	128.0	0.5	0.0	0.0
127.0	127.0	0.5	0.0	0.0
126.0	126.0	0.5	0.0	0.0
125.0	125.0	0.5	0.0	0.0
124.0	124.0	0.5	0.0	0.0
123.0	123.0	0.5	0.0	0.0
122.0	122.0	0.5	0.0	0.0
121.0	121.0	0.5	0.0	0.0
120.0	120.0	0.5	0.0	0.0
119.0	119.0	0.5	0.0	0.0
118.0	118.0	0.5	0.0	0.0
117.0	117.0	0.5	0.0	0.0
116.0	116.0	0.5	0.0	0.0
115.0	115.0	0.5	0.0	0.0
114.0	114.0	0.5	0.0	0.0
113.0	113.0	0.5	0.0	0.0
112.0	112.0	0.5	0.0	0.0
111.0	111.0	0.5	0.0	0.0
110.0	110.0	0.5	0.0	0.0
109.0	109.0	0.5	0.0	0.0
108.0	108.0	0.5	0.0	0.0
107.0	107.0	0.5	0.0	0.0
106.0	106.0	0.5	0.0	0.0
105.0	105.0	0.5	0.0	0.0
104.0	104.0	0.5	0.0	0.0
103.0	103.0	0.5	0.0	0.0
102.0	102.0	0.5	0.0	0.0
101.0	101.0	0.5	0.0	0.0
100.0	100.0	0.5	0.0	0.0
99.0	99.0	0.5	0.0	0.0
98.0	98.0	0.5	0.0	0.0
97.0	97.0	0.5	0.0	0.0
96.0	96.0	0.5	0.0	0.0
95.0	95.0	0.5	0.0	0.0
94.0	94.0	0.5	0.0	0.0
93.0	93.0	0.5	0.0	0.0
92.0	92.0	0.5	0.0	0.0
91.0	91.0	0.5	0.0	0.0
90.0	90.0	0.5	0.0	0.0
89.0	89.0	0.5	0.0	0.0
88.0	88.0	0.5	0.0	0.0
87.0	87.0	0.5	0.0	0.0
86.0	86.0	0.5	0.0	0.0

Nom. Value	Meas. Value	Tolerance Limits	Dev. In the last 1 dB	Deviation Rel. to 94.0 dB
[dB]	[dB]	[dB]	[dB]	[dB]
85.0	85.0	0.5	0.0	0.0
84.0	84.0	0.5	0.0	0.0
83.0	83.0	0.5	0.0	0.0
82.0	82.0	0.5	0.0	0.0
81.0	81.0	0.5	0.0	0.0
80.0	80.0	0.5	0.0	0.0
79.0	79.0	0.5	0.0	0.0
78.0	78.0	0.5	0.0	0.0
77.0	77.0	0.5	0.0	0.0
76.0	76.0	0.5	0.0	0.0
75.0	75.0	0.5	0.0	0.0
74.0	74.0	0.5	0.0	0.0
73.0	73.0	0.5	0.0	0.0
72.0	72.0	0.5	0.0	0.0
71.0	71.0	0.5	0.0	0.0
70.0	70.0	0.5	0.0	0.0
69.0	69.0	0.5	0.0	0.0
68.0	68.0	0.5	0.0	0.0
67.0	67.0	0.5	0.0	0.0
66.0	66.0	0.5	0.0	0.0
65.0	65.0	0.5	0.0	0.0
64.0	64.0	0.5	0.0	0.0
63.0	63.0	0.5	0.0	0.0
62.0	62.0	0.5	0.0	0.0
61.0	61.0	0.5	0.0	0.0
60.0	60.0	0.5	0.0	0.0
59.0	59.0	0.5	0.0	0.0
58.0	58.0	0.5	0.0	0.0
57.0	57.0	0.5	0.0	0.0
56.0	56.0	0.5	0.0	0.0
55.0	55.0	0.5	0.0	0.0
54.0	54.0	0.5	0.0	0.0
53.0	53.0	0.5	0.0	0.0
52.0	52.0	0.5	0.0	0.0
51.0	51.0	0.5	0.0	0.0
50.0	50.0	0.5	0.0	0.1
49.0	49.1	0.5	0.1	0.1
48.0	48.1	0.5	0.0	0.1
47.0	47.0	0.5	0.0	0.1
46.0	46.1	0.5	0.1	0.1
45.0	45.1	0.5	0.0	0.2
44.0	44.1	0.5	-0.1	0.1
43.0	43.1	0.5	0.0	0.1
42.0	42.2	0.5	0.1	0.2
41.0	41.1	0.5	-0.1	0.1
40.0	40.1	0.5	0.0	0.1
39.0	39.2	0.5	0.1	0.2
38.0	38.1	0.5	-0.1	0.2
37.0	37.0	0.5	-0.2	0.0
36.0	36.3	0.5	0.4	0.4

Linearity Range at 1kHz, IEC61672 - 3 (14)

ANSI/ASA S1.4 - 2014 / Part 3 - 17

This document shall not be reproduced, except in full, without the written approval from West Caldwell Cal. Labs. Inc.

Rev. 7.0 Jan. 24, 2014 Doc. # 1036 2250B&K

Test Function			Tolerance		Value	Measured values		
			Min	Max			Out	
,0.	Reading with 94.0dB SPL Absolute Acoustical Sensitivity Level, IEC 61672 - 3 (9) ANSI/ASA S1.4 - 2014 / Part 3. -10	dB	93.7	94.3	94	94.0		
,0.	Determining Electrical Level for 1V at 1kHz		119.7	120.3	120	120.0		
,1.	Attenuator accuracy Linearity Range at 1kHz, IEC61672 - 3 (14) ANSI/ASA S1.4 - 2014 / Part 3 - 17				FSD (dB)			
			34.6	35.4	35	35.0		
			39.6	40.4	40	40.1		
			44.6	45.4	45	45.1		
			49.6	50.4	50	50.0		
			54.6	55.4	55	55.0		
			59.6	60.4	60	60.0		
			64.6	65.4	65	65.0		
			69.6	70.4	70	70.0		
			74.6	75.4	75	75.0		
			79.6	80.4	80	80.0		
			84.6	85.4	85	85.0		
			89.6	90.4	90	90.0		
			94.6	95.4	95	95.0		
			99.6	100.4	100	100.0		
			104.6	105.4	105	105.0		
			109.6	110.4	110	110.0		
			114.6	115.4	115	115.0		
			119.6	120.4	120	120.0		
			124.6	125.4	125	125.0		
			129.6	130.4	130	130.0		
	134.6	135.4	135	135.0				
,2	Frequency Response with mic. A Weighting Ref. 94.0 dB @ 1kHz Frequency Weightings at A - Weighting 1kHz, IEC 61672-3 (13) ANSI/ASA S1.4 - 2014 / Part 3 -12				(Hz)			
			53.3	55.9	31.5	55.1		
			67.0	68.6	63.1	68.0		
			77.1	78.7	125	78.0		
			84.6	86.2	250	85.5		
			90.0	91.6	500	90.9		
			93.2	94.8	1000	94.2		
			94.4	96.0	2000	95.4		
			94.2	95.8	4000	95.2		
			90.1	94.2	8000	93.3		
			83.9	92.5	12500	90.2		
			0.0	90.2	16000	88.1		
					(Hz)			
			89.7	92.3	31.5	91.3		
			92.4	94.0	63	93.3		
			93.0	94.6	125	94.0		
			93.2	94.8	250	94.1		
			93.2	94.8	500	94.1		
			93.2	94.8	1000	94.2		
			93.0	94.6	2000	94.0		
			92.4	94.0	4000	93.4		
	88.2	92.3	8000	91.5				
	82.0	90.6	12500	88.3				
	0.0	88.3	16000	86.2				

Test Function	Tolerance		Value	Measured values	
	Min	Max			Out
Z Weighting Frequency Weightings at Z - Weighting 1kHz, IEC 61672-3 (13) ANSI/ASA S1.4 - 2014 / Part 3 -12	92.7	95.3	(Hz) 31.5	94.3	
	93.2	94.8	63	94.2	
	93.2	94.8	125	94.1	
	93.2	94.8	250	94.1	
	93.2	94.8	500	94.1	
	93.2	94.8	1000	94.2	
	93.2	94.8	2000	94.2	
	93.2	94.8	4000	94.3	
	91.2	95.3	8000	94.4	
	88.2	96.8	12500	94.6	
	0.0	96.8	16000	94.6	
Frequency Response with Electrical Signal A Weighting Ref. 94.0 dB @ 1kHz Frequency Response measured with Electrical Signal, Freq. Weig. A with HP filter, IEC 61672 Class 1 (12) ANSI/ASA S1.4 - 2014 / Part 3 -13	67.1	71.9	(Hz) 20.0	69.4	
	73.4	77.2	25.1	75.2	
	79.2	82.0	31.6	80.5	
	84.0	86.8	39.8	85.4	
	88.9	90.7	50.1	89.8	
	92.9	94.7	63.1	93.8	
	96.6	98.4	79.4	97.5	
	100.0	101.8	100.0	100.9	
	103.0	104.8	125.9	103.9	
	105.7	107.5	158.5	106.7	
	108.2	110.0	199.5	109.1	
	110.5	112.3	251.2	111.4	
	112.5	114.3	316.2	113.4	
	114.3	116.1	398.1	115.2	
	115.9	117.7	501.2	116.8	
	117.2	119.0	631.0	118.1	
	118.3	120.1	794.3	119.2	
	119.1	120.9	1000.0	120.0	
	119.7	121.5	1258.9	120.6	
	120.1	121.9	1584.9	121.0	
	120.3	122.1	1995.3	121.2	
	120.3	122.2	2511.9	121.3	
	120.3	122.1	3162.3	121.2	
	120.1	121.9	3981.1	121.0	
	119.6	121.9	5011.9	120.6	
	118.0	121.3	6309.6	119.9	
	116.0	120.3	7943.3	118.9	
	113.6	119.4	10000.0	117.4	
	109.8	118.6	12589.3	115.2	
	112.1	116.3	15848.9	112.5	
	0.0	113.6	19952.6	111.1	

Test Function	Tolerance		Value	Measured values	
	Min	Max			Out
C Weighting Frequency Response measured with Electrical Signal, Freq. Weig. C with HP filter, IEC 61672 Class 1 (12) ANSI/ASA S1.4 - 2014 / Part 3 -13			(Hz)		
	111.4	116.2	20.0	113.8	
	113.7	117.5	25.1	115.6	
	115.6	118.4	31.6	116.9	
	116.6	119.4	39.8	118.1	
	117.8	119.6	50.1	118.7	
	118.3	120.1	63.1	119.1	
	118.6	120.4	79.4	119.5	
	118.8	120.6	100.0	119.7	
	118.9	120.7	125.9	119.8	
	119.0	120.8	158.5	119.9	
	119.1	120.9	199.5	120.0	
	119.1	120.9	251.2	120.0	
	119.1	120.9	316.2	120.0	
	119.1	120.9	398.1	120.0	
	119.1	120.9	501.2	120.0	
	119.1	120.9	631.0	120.0	
	119.1	120.9	794.3	120.0	
	119.1	120.9	1000.0	120.0	
	119.1	120.9	1258.9	120.0	
	119.0	120.8	1584.9	119.9	
	118.9	120.7	1995.3	119.8	
	118.8	120.6	2511.9	119.7	
	118.6	120.4	3162.3	119.5	
	118.3	120.1	3981.1	119.2	
	117.8	120.1	5011.9	118.7	
	116.1	119.4	6309.6	118.0	
	114.1	118.4	7943.3	117.0	
	111.7	117.5	10000.0	115.5	
	107.9	116.7	12589.3	113.3	
	110.1	114.4	15848.9	110.6	
	105.1	111.7	19952.6	109.2	

Test Function	Tolerance		Value	Measured values	
	Min	Max			Out
Z Weighting	118.6	121.4	(Hz) 20.0	120.1	
Frequency Response measured with Electrical Signal,	118.6	121.4	25.1	120.0	
Freq. Weig. Z with HP filter, IEC 61672 Class 1 (12)	118.6	121.4	31.6	120.0	
ANSI/ASA S1.4 - 2014 / Part 3 -13	118.6	121.4	39.8	119.9	
	118.6	121.4	50.1	120.0	
	119.1	120.9	63.1	120.0	
	119.1	120.9	79.4	120.0	
	119.1	120.9	100.0	120.0	
	119.1	120.9	125.9	120.0	
	119.1	120.9	158.5	120.0	
	119.1	120.9	199.5	120.0	
	119.1	120.9	251.2	120.0	
	119.1	120.9	316.2	120.0	
	119.1	120.9	398.1	120.0	
	119.1	120.9	501.2	120.0	
	119.1	120.9	631.0	120.0	
	119.1	120.9	794.3	120.0	
	119.1	120.9	1000.0	120.0	
	119.1	120.9	1258.9	120.0	
	119.1	120.9	1584.9	120.0	
	119.1	120.9	1995.3	120.0	
	119.1	120.9	2511.9	120.0	
	119.1	120.9	3162.3	120.0	
	119.1	120.9	3981.1	120.0	
	117.1	121.4	5011.9	120.0	
	117.1	121.4	6309.6	120.0	
	117.1	121.4	7943.3	120.0	
	114.1	122.9	10000.0	119.9	
	114.1	122.9	12589.3	119.6	
	110.1	122.9	15848.9	119.1	
	110.1	122.9	19952.6	120.2	
4 Inherent noise level					
Electrical Inherent Noise Level, Freq. Weig. Lin, IEC 61672-3 (10)					
ANSI/ASA S1.4 - 2014 / Part 3 -11					
Z Fast	less than	27		15.62	
Z Slow	less than	20		15.6	
Z Impulse	less than	30		16.11	
Z Leq	less than	20		15.68	
Z Peak	less than	32		25.84	
Z Max	less than	32		16.3	
C Fast	less than	27		12.52	
C Slow	less than	20		12.57	
C Impulse	less than	30		12.74	
C Leq	less than	20		12.52	
C Peak	less than	32		25.39	
C Max	less than	32		12.77	
A Fast	less than	27		12.54	
A Slow	less than	20		12.54	
A Impulse	less than	30		12.6	
A Leq	less than	20		12.53	
A Peak	less than	32		24.73	
A Max	less than	32		12.6	

Test Function		Tolerance		Value	Measured values	
		Min	Max			Out
,5	Random signal	dB	dB			
	90 dB Test Level	89.5	90.5	Fast	90.2	
	Overload Indication IEC 61672 - 3 (18)	89.5	90.5	Slow	90.0	
	ANSI/ASA S1.4 - 2014 / Part 3 -20				140.0	
,6	Time Constant	dB	dB			
	90 dB 2kHz Test Level	88.0	89.5	Fast	89.2	
		84.0	88.0	Slow	86.7	
,7	Functions					
	ANSI/ASA S1.4 - 2014 / Part 3 -12					
	Z Fast	93.5	94.5	94.0	94.0	
	Z Slow	93.5	94.5	94.0	94.0	
	Z Impulse	93.5	94.5	94.0	94.0	
	Z Leq	93.5	94.5	94.0	94.0	
	Z Peak	96.0	98.0	97.0	97.3	
	Z Max	93.5	94.5	94.0	94.0	
	C Fast	93.5	94.5	94.0	94.0	
	C Slow	93.5	94.5	94.0	94.0	
	C Impulse	93.5	94.5	94.0	94.0	
	C Leq	93.5	94.5	94.0	94.0	
	C Peak	96.0	98.0	97.0	97.3	
	C Max	93.5	94.5	94.0	94.0	
	A Fast	93.5	94.5	94.0	94.0	
	A Slow	93.5	94.5	94.0	94.0	
	A Impulse	93.5	94.5	94.0	94.0	
	A Leq	93.5	94.5	94.0	94.0	
	A Peak	96.0	98.0	97.0	97.1	
	A Max	93.5	94.5	94.0	94.0	
	Peak C Level 8kHz Sine IEC 61672 - 3 Class 1 (17)	-5.4	-1.4	Peak	-3.33	
	Peak C Level 500Hz Positive Pulse IEC 61672 - 3 Class 1 (17)	-3.4	-1.4	Peak	-3.3	
	Peak C Level 500Hz Negative Pulse IEC 61672 - 3 Class 1 (17)	-3.4	-1.4	Peak	-3.1	
	Frequency Weightings at A Fast - Weighting 1kHz, IEC 61672-3 (13)	93.6	94.4	94.0	94.2	
	Frequency Weightings at C Fast - Weighting 1kHz, IEC 61672-3 (13)	93.6	94.4	94.0	94.2	
	Frequency Weightings at Z Fast- Weighting 1kHz, IEC 61672-3 (13)	93.6	94.4	94.0	94.2	
	Time Weighting Response to Single Burst, 4kHz, 200ms, F Class 1, IEC61672 - 3 (16)	-1.5	0.5		-1.0	
	Time Weighting Response to Single Burst, 4kHz, 2ms, F Class 1, IEC61672 - 3 (16)	-19.5	-17		-18.1	
	Time Weighting Response to Single Burst, 4kHz, 0.25ms, F Class 1, IEC61672 - 3 (16)	-30	-26		-27.2	
	Time Weighting Response to Single Burst, 4kHz, 200ms, S Class 1, IEC61672 - 3 (16)	-7.9	-6.4		-7.4	
	Time Weighting Response to Single Burst, 4kHz, 2ms, S Class 1, IEC61672 - 3 (16)	-27.5	-26.5		-27.1	
	ANSI/ASA S1.4 - 2014 / Part 3 - 18					
	Acoustic test at 4kHz.					
	A Weig.					
	A Fast	94.5	95.5	95.0	95.2	
	A Slow	94.5	95.5	95.0	95.2	
	A Impulse	94.5	95.5	95.0	95.2	
	A Leq	94.5	95.5	95.0	95.2	
	A Peak	97.0	99.0	98.0	98.1	
	A Max	94.5	95.5	95.0	95.2	

Test Function					
,8 1/3 Octave filter check					
Filter Hz		87.5 to 92.5	93.5 to 94.5	87.5 to 92.5	Out
12.5		90.5	94.0	90.4	
16		90.4	94.0	90.4	
20		90.3	94.0	90.3	
25.12		90.4	94.0	90.4	
31.62		90.3	94.0	90.5	
39.81		90.2	94.0	90.3	
50.12		90.3	94.0	90.4	
63.1		90.3	94.0	90.4	
79.43		90.3	94.0	90.4	
100		90.2	94.0	90.2	
125.89		90.5	94.0	90.3	
158.49		90.4	94.0	90.3	
199.53		90.3	94.0	90.3	
251.19		90.4	94.0	90.4	
316.23		90.3	94.0	90.5	
398.11		90.2	94.0	90.4	
501.19		90.3	94.0	90.4	
630.96		90.3	94.0	90.4	
794.33		90.3	94.0	90.4	
1000		90.3	94.0	90.2	
1258.93		90.5	94.0	90.3	
1584.89		90.4	94.0	90.4	
1995.26		90.3	94.0	90.3	
2511.89		90.4	94.0	90.4	
3162.28		90.4	94.0	90.5	
3981.07		90.3	94.0	90.4	
5011.87		90.4	94.0	90.5	
6309.57		90.3	94.1	90.4	
7943.28		90.3	94.0	90.4	
10000		90.3	93.9	90.0	
12589.25		90.3	93.6	89.6	
15848.93		89.7	94.1	89.8	
19952.62		89.7	94.3	91.3	

1/1-Octave and 1/3-Octave Filter Fulfils ANSI/ASA S1.11 -1-2004 and IEC61260-1 : 2014 specification.

1/1 Octave Filter Check					
Filter Hz		88.5 to 92.4	93.5 to 94.5	88.5 to 92.4	Out
16		90.4	94.0	90.4	
31.5		90.4	94.0	90.4	
63		90.4	94.0	90.4	
125		90.4	94.0	90.4	
250		90.3	94.0	90.4	
500		90.4	94.0	90.4	
1K		90.4	94.0	90.4	
2K		90.4	94.0	90.4	
4k		90.4	94.0	90.4	
8k		90.4	94.0	90.4	
16k		90.4	94.0	90.5	

The expanded uncertainty of calibration at 95% confidence level with a coverage factor of k=2.

Parameter	Test Instrumentation Uncertainty	DUT Uncertainty	Total DUT Uncertainty
Reading with mic. @ 1kHz:	0.071	0.1	0.12
Meter linearity:	0.011	0.1	0.10
Attenuator accuracy:	0.17	0.1	0.20
Freq. Response: 63Hz to 8kHz	0.094	0.1	0.14
Freq. Response: 12.5kHz & 16kHz	0.1	0.1	0.14
Electrical Freq. Resp.: 20Hz to 20kHz	0.024	0.1	0.10
Inherent noise level:	0.056	0.1	0.11
Crest Factor:	0.056	0.1	0.11
Time Constant:	0.056	0.1	0.11
Overload:	0.056	0.1	0.11
Functions:	0.09	0.1	0.13
Sensitivity:	0.13	0.1	0.16
1/3 & 1/1 Filters:	0.011	0.1	0.10

Cal. Date: 15-Aug-2017

Measurements By: Kent Zeng

Calibrated on WCCL system type 9700

This document shall not be reproduced, except in full, without the written approval from West Caldwell Cal. Labs. Inc.

Rev. 7.0 Jan. 24, 2014 Doc. # 1038 2250B&K

West Caldwell Calibration Laboratories Inc.

Certificate of Calibration

for

MICROPHONE

Manufactured by: BRUEL & KJAER
Model No: 4189
Serial No: 3036522
Calibration Recall No: 27919

Submitted By:

Customer:
Company: Aercoustics Engineering Ltd.
Address:

The subject instrument was calibrated to the indicated specification using standards traceable to the National Institute of Standards and Technology or to accepted values of natural physical constants. This document certifies that the instrument met the following specification upon its return to the submitter.

West Caldwell Calibration Laboratories Procedure No. 4189 BRUE

Upon receipt for Calibration, the instrument was found to be:

Within (X)

tolerance of the indicated specification. See attached Report of Calibration.

West Caldwell Calibration Laboratories' calibration control system meets the requirements, ISO 10012-1 MIL-STD-45662A, ANSI/NCSL Z540-1, IEC Guide 25, ISO 9001:2008 and ISO 17025.

Note: With this Certificate, Report of Calibration is included.

Approved by: FC

Calibration Date: 15-Aug-17

Felix Christopher (QA Mgr.)

Certificate No: 27919 - 12

QA Doc. #1051 Rev. 2.0 10/1/01

Certificate Page 1 of 1

ISO/IEC 17025:2005

**West Caldwell
Calibration
Laboratories, Inc.**
uncompromised calibration
1575 State Route 96, Victor, NY 14564, U.S.A.



Calibration Lab. Cert. # 1533.01

**West Caldwell
Calibration
Laboratories, Inc.**
uncompromised calibration
1575 State Route 96, Victor NY 14564



REPORT OF CALIBRATION

Brüel & Kjær Microphone

for
Model No.: 4189

Serial No.: 3036522

Company: Aercoustics Engineering Ltd

ID No.: XXXX

Calibration results:

Before & after data same: ...X...

Sensitivity @ 250 Hz and pressure of 98.88 kPa

0 Volts Polarization voltage (External):

-26.82 dB re.1V/Pascal

45.58 mV/Pascal

0.82 Ko (- dB re 50 mV/Pascal)

Sensitivity: Pass

Freq. Response: Pass

All tests: Pass

Ambient Temperature: 22.3 °C

Ambient Humidity: 52.6 % RH

Ambient Pressure: 98.883 kPa

Calibration Date: 15-Aug-2017

Calibration Due: 15-Aug-2019

Report Number: 27919 -12

Control Number: 27919

The above listed instrument meets or exceeds the tested manufacturer's specifications.


The IEC 651:1979 & 1993 Type 1 specification passed.

This Calibration is traceable through NIST test numbers: 683/284413-14

The expanded uncertainty of calibration: 0.079dB at 95% confidence level with a coverage factor of k=2.

The pressure response recorded with electroacoustic method.

Frequency Response

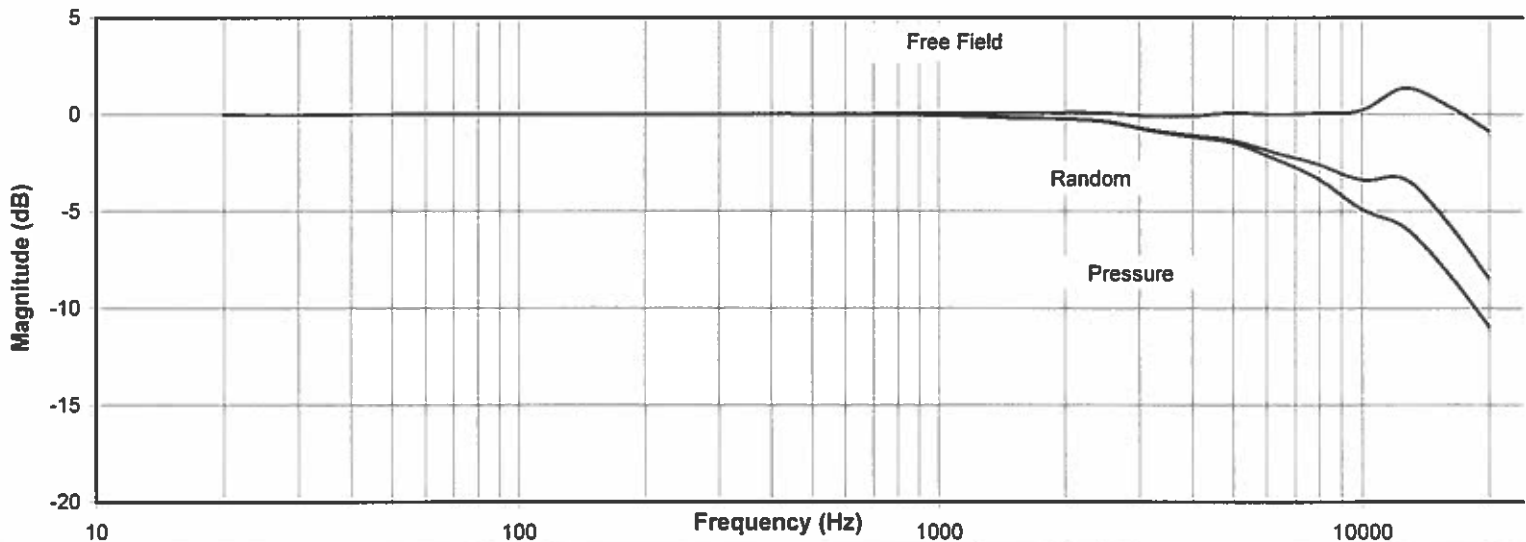

The above listed instrument was checked using calibration procedure documented in West Caldwell

Calibration Laboratories Inc. procedure :

Rev. 7.0 Jan. 24, 2014 Doc. # 1038 P4189B&K

Calibration was performed by West Caldwell Calibration Laboratories Inc. under Operating Procedures

intended to implement the requirements of ISO10012-1, IEC Guide 25, ANSI/NCSS Z540-1, (MIL-STD-45662A) and ISO 9001:2008, ISO 17025

Measurements performed by:

Kent Zeng

Calibrated on WCCL system type 9700

This document shall not be reproduced, except in full, without the written approval from West Caldwell Cal. Labs. Inc.

Rev. 7.0 Jan. 24, 2014 Doc. # 1038 P4189B&K

West Caldwell Calibration Laboratories Inc.

1575 State Route 96, Victor NY 14564

Tel. (585) 586-3900 FAX (585) 586-4327

Calibration Data Record

for

Model No.: 4189

Brüel & Kjær Microphone

Company: Aercoustics Engineering Ltd

Serial No.: 3036522

ID No.: XXXX

Frequency Response (Reference = 0 dB @ 250Hz)

Frequency [Hz]	Pressure [dB]	Free Field [dB]	Random [dB]
19.95	-0.02	-0.02	-0.02
25.12	-0.05	-0.05	-0.05
31.62	-0.03	-0.03	-0.03
39.81	-0.02	-0.02	-0.02
50.12	0.00	0.00	0.00
63.10	0.00	0.00	0.00
79.43	-0.01	-0.01	-0.01
100.00	0.01	0.01	0.01
125.89	0.00	0.00	0.00
158.49	0.00	0.00	0.00
199.53	0.01	0.01	0.01
251.19	0.00	0.00	0.00
316.23	0.00	0.01	0.00
398.11	0.00	0.01	0.00
501.19	-0.01	0.01	-0.01
630.96	-0.02	0.02	-0.02
794.33	-0.04	0.03	-0.04
1000.00	-0.07	0.03	-0.09
1258.93	-0.10	0.05	-0.14
1584.89	-0.18	0.04	-0.23
1995.26	-0.25	0.08	-0.25
2511.89	-0.42	0.05	-0.38
3162.28	-0.83	-0.12	-0.80
3981.07	-1.16	-0.10	-1.08
5011.87	-1.49	0.08	-1.35
6309.57	-2.30	-0.02	-1.99
7943.28	-3.32	0.06	-2.57
10000.00	-4.91	0.21	-3.38
12589.25	-5.84	1.35	-3.33
15848.93	-8.12	0.46	-5.54
19952.62	-10.91	-0.86	-8.43

Freq. response: Expanded Uncertainty (dB) with coverage factor K = 2

20 to 63Hz 0.1dB, 63 to 12.5kHz 0.094dB, 12.5k to 16kHz 0.10dB, 16k to 20kHz 0.5dB.

Instruments used for calibration:			Date of Cal.	Traceability No.	Re-cal. Due Date
Brüel & Kjær	4226	S/N 1445428	3-Nov-2016	683/284413-14	3-Nov-2017
Brüel & Kjær	3560	S/N 2202374	3-Nov-2016	683/284413-14	3-Nov-2017
HP	33120A	S/N 36043716	1-Oct-2016	,287708	1-Oct-2017
HP	34401A	S/N 36064102	1-Oct-2016	,287708	1-Oct-2017

Cal. Date: 15-Aug-2017

Tested by: Kent Zeng


Calibrated on WCCL system type 9700

This document shall not be reproduced except in full without the written approval from West Caldwell Cal. Labs, Inc.

Rev. 7.0 Jan. 24, 2014 Doc. # 1038 P4189B&K

Appendix D

Sample Tone Plot

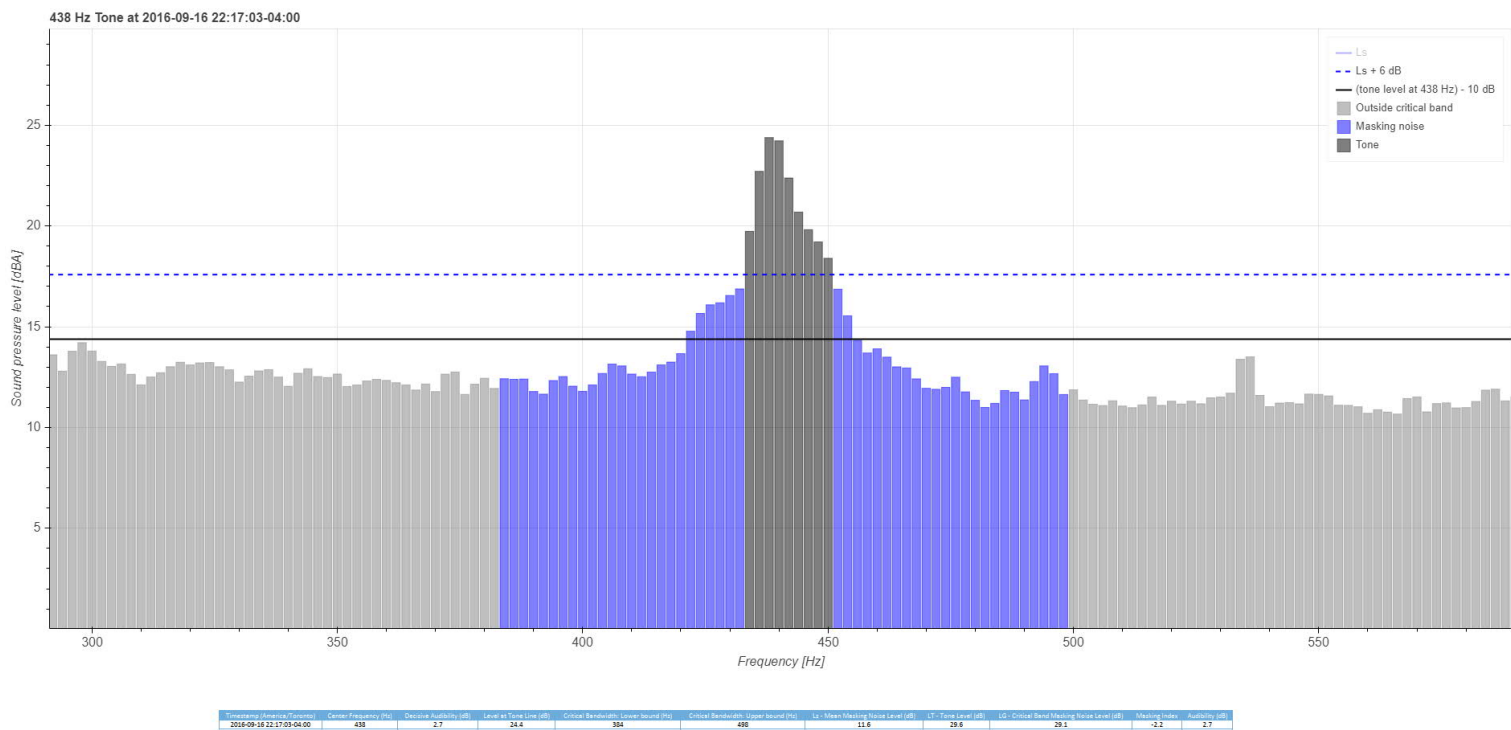

Project ID: 15247.00
Drawn by: IK
Reviewed by: AM
Date: August 29, 2019
Revision: 1

Scale: As Indicated

Armow Wind Power Project
 Tonal Assessment R221

Appendix

Sample Tone Plot - R221 -
 Turbine ON 3m/s

Appendix E

AWPP Scope of Work



SP Armow Wind Ontario LP
2050 Derry Road Wst, 2nd Floor
Mississauga, Ontario L5N 0B0
Canada

July 26, 2019

BY EMAIL

Director
Ministry of the Environment, Conservation and Parks
Owen Sound District Office
101 17th St., 3rd Floor
Owen Sound, ON N4K 0A5
John.S.Ritchie@ontario.ca

Dear Mr. Ritchie:

SP Armow Wind Ontario GP Inc. ("Armow") v. Ontario (Environment, Conservation and Parks)
ERT File No. 19-051

We are writing with respect to Director's Order No. 2868-B8VRY4-1 dated June 19, 2019 (the "Order"), the Director's letter of June 27, 2019 and Armow's appeal of the Order to the Environmental Review Tribunal ("ERT"). Given the extremely complex technical nature of the Order, please find below the scope of work that Armow will conduct to comply with the Order:

- 1) With respect to Work Ordered Items Nos. 1, 2, 3 and 4 as set out in the Order, all work has been completed and no further action is required.
- 2) With respect to Work Ordered Item No. 5, such work to be conducted as set out below:

By March 1, 2020, have the Acoustical Consultant conduct a RAM I-Audit, in accordance with The Compliance Protocol for Wind Turbine Noise published April 2017 (the "2017 Compliance Protocol") regarding equipment set-up requirements, with measurement of tonality to be undertaken in accordance with ISO 1996-2:2017 for the following:

- a) the wind turbines identified in the REA as T68 and T80; and
- b) the location of a worst-case noise receptor.

Monitoring locations for both T68 and T80 may be moved southward if remaining within same line-of-sight for T68 and distance correction factor is used (the more conservative of: 20 log rule or CADNA prediction). Any tonal penalties will be applied in accordance with sections E5.1 and E5.5.2 of the 2017 Compliance Protocol.

- 3) With respect to Work Ordered Item No. 6, such work to be conducted as set out below:

By March 1, 2020, have the Acoustical Consultant complete tonality measurements in accordance with ISO 1996-2:2017 (and 2017 Compliance Protocol regarding equipment set-up requirements) for each of the six (6) wind turbines identified in the REA as T50, T30, T88, T102, T75 and T95 and in accordance with the following turbine-specific requirements:

- a) T95 will be addressed through a receptor in the crosswind direction, or other receptor that is located at similar distance downwind from a turbine of the same model;
- b) T50 and T102 will be addressed through separate respective receptors in the downwind direction (prior measurements conducted at receptor IDs V556 and R215 may be used to fulfil tonality assessments, provided data meets the requirement of: "At least five (5) one-minute measurements per wind speed bin over entire assessment range of the turbine and not limited to wind speed bins of 4-7 m/s as per Compliance Protocol"); and
- c) T30, T88, T75 will be addressed through alternative surrogate receptors, as the closest respective receptors are in the upwind direction (taking into account the following factors: same turbine model type, extent to which permission for site access is provided/withheld, and minimization of noise source contamination).

Any tonal penalties will be applied in accordance with sections E5.1 and E5.5.2 of the 2017 Compliance Protocol.


- 4) Completion of Work Ordered Item No. 7, as set out in the Order.
- 5) Completion of Work Ordered Item No. 8, as set out in the Order, by submitting a noise abatement action plan prepared in accordance with sections E5.1 and E5.5.2 of the 2017 Compliance Protocol.

This letter describes the whole scope of work that Armow proposes to complete in satisfaction of the Order. Please confirm the foregoing will allow for compliance with the Order. If such confirmation is received, Armow will proceed to withdraw its ERT appeal and implement this scope of work.

Yours truly,

SP Armow Wind Ontario LP,
by its general partner
SP Armow Wind Ontario GP Inc.

Per: 
Name: Frank Davis
Title: Authorized Signatory

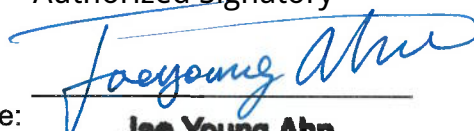Per: 
Name: **Jae Young Ahn**
Title: **Authorized Signatory**